


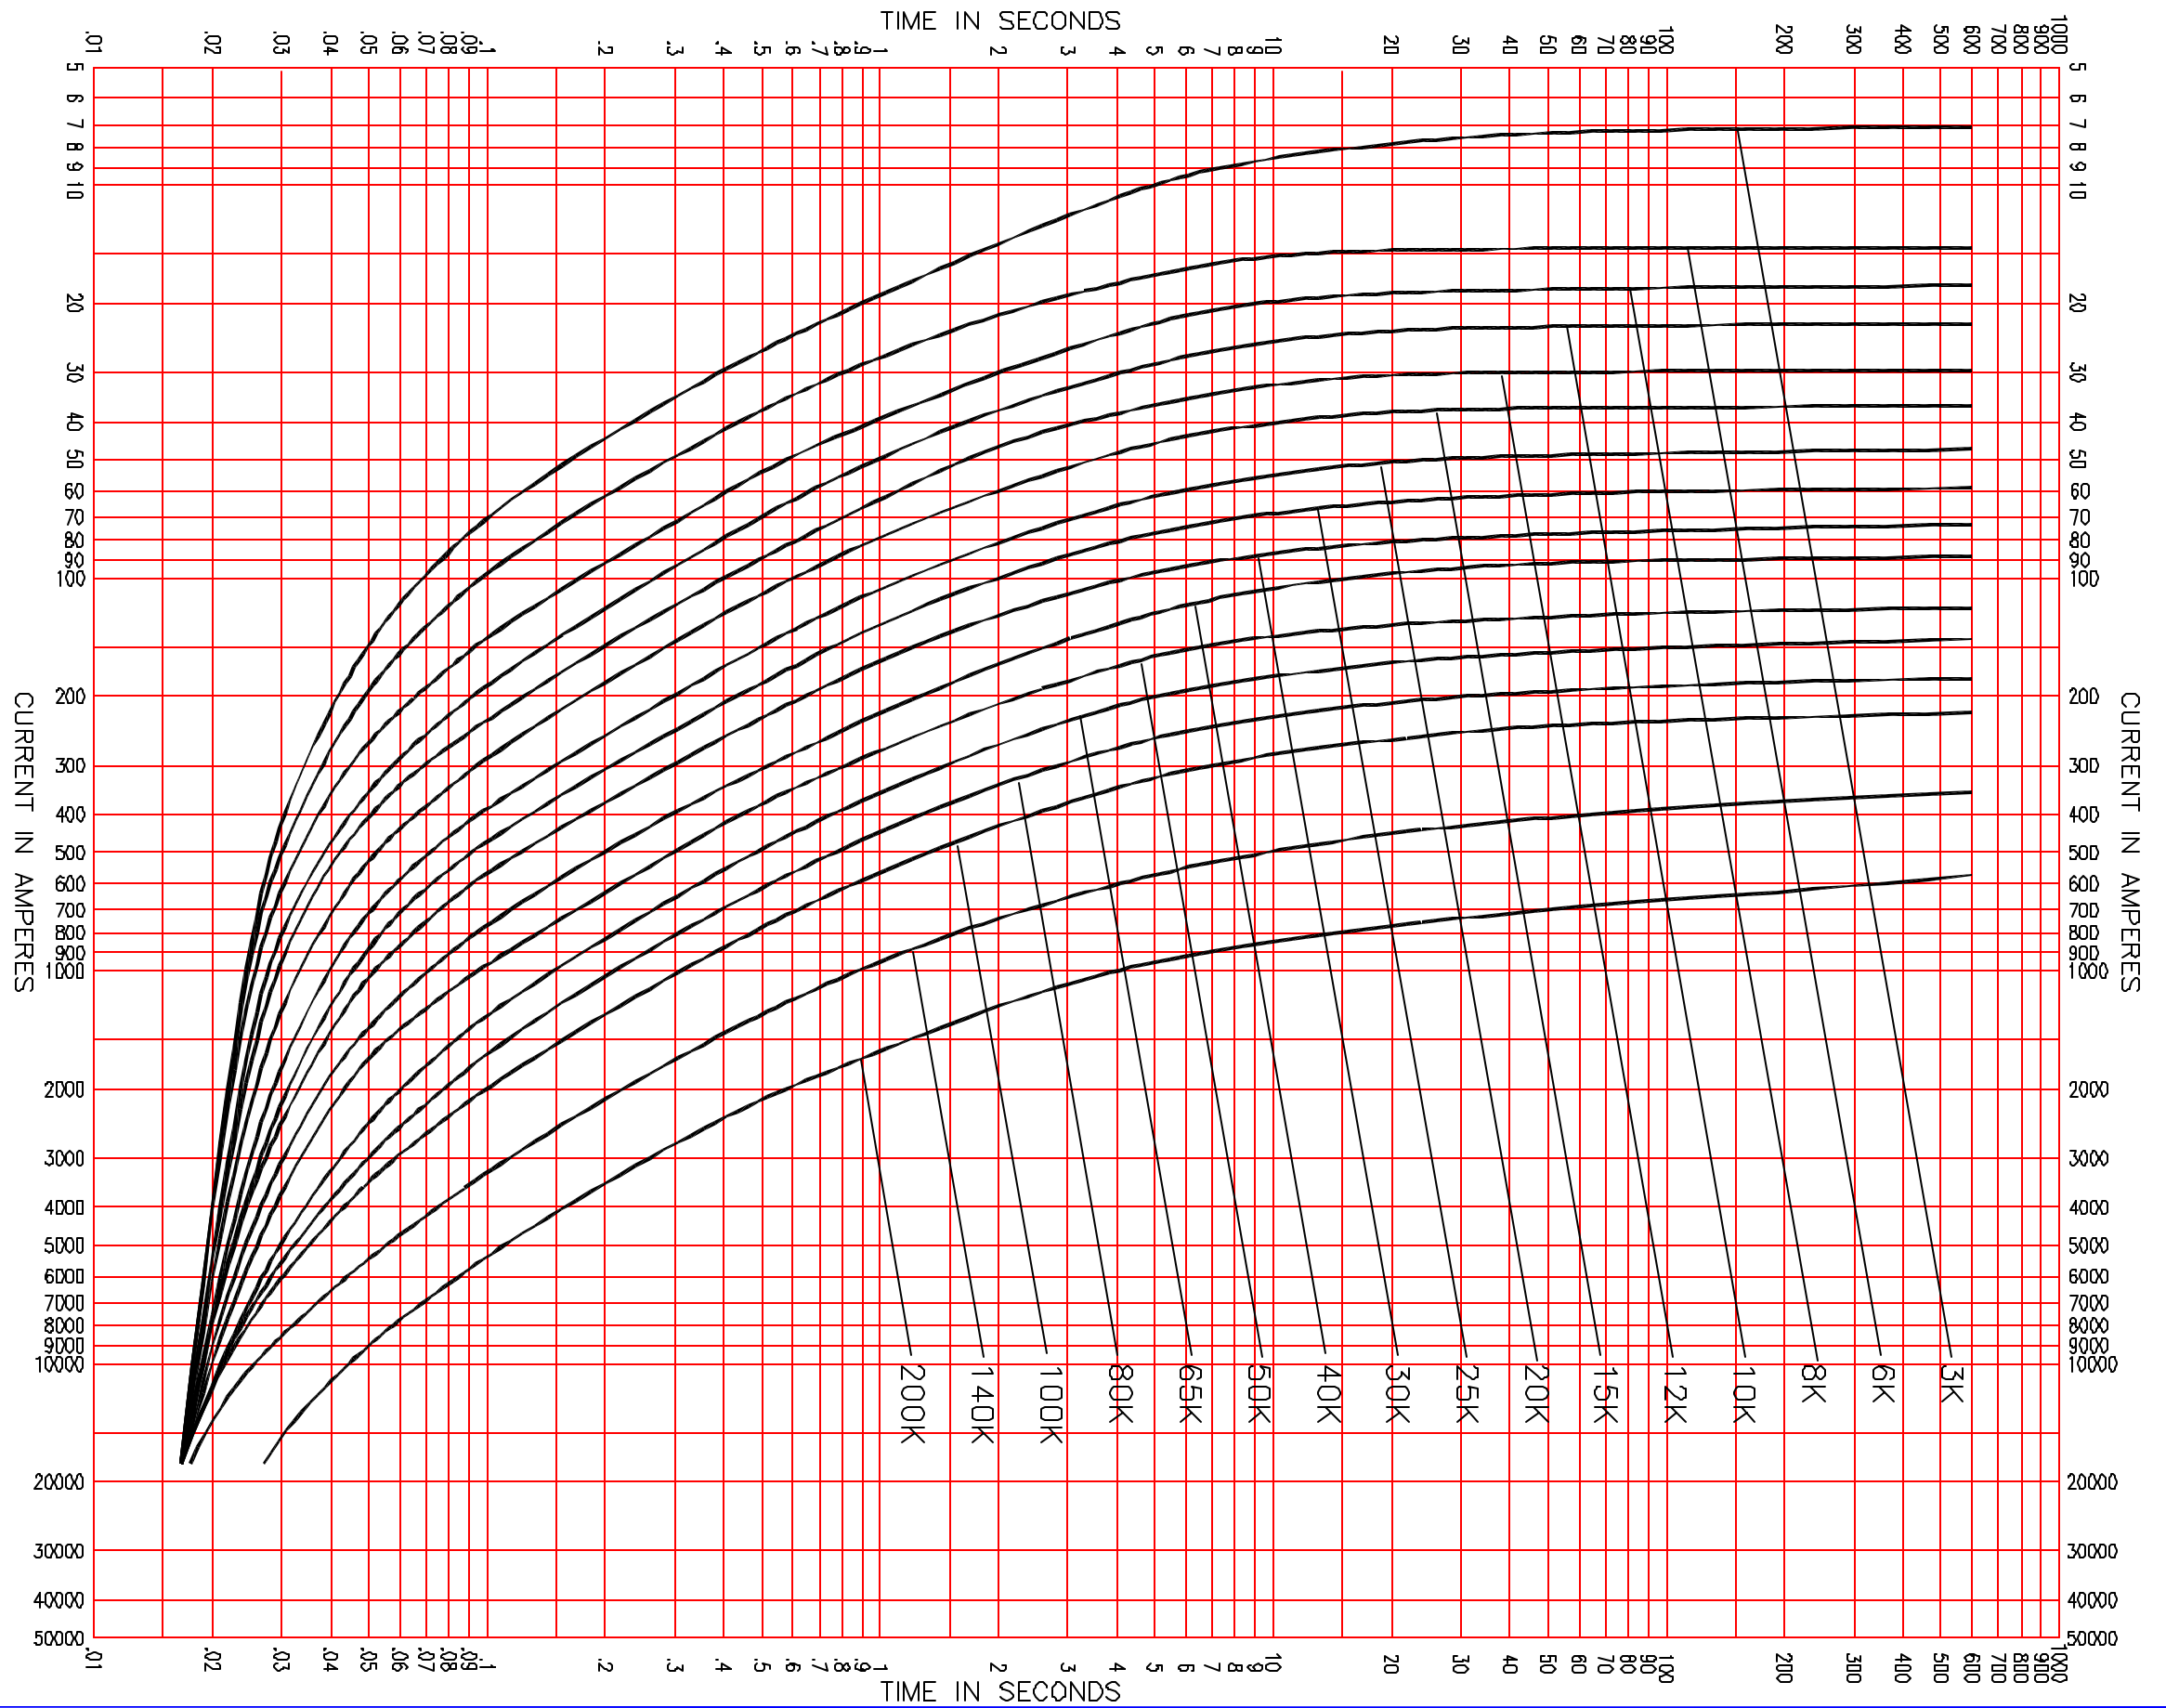

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT				TIME—CURRENT CHARACTERISTICS CURVES			
DRAWN BY CSR		CHK'D		Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load			
DATE 03/24/05		DATE		Standards used as basis for data: IEEE 37.41-1994 & ANSI C37.42-1981(R1992)			
REPLACES 06/01		REV 02	REQ NO.	MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS			
DWG NO.	42	39833	B 00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.			