


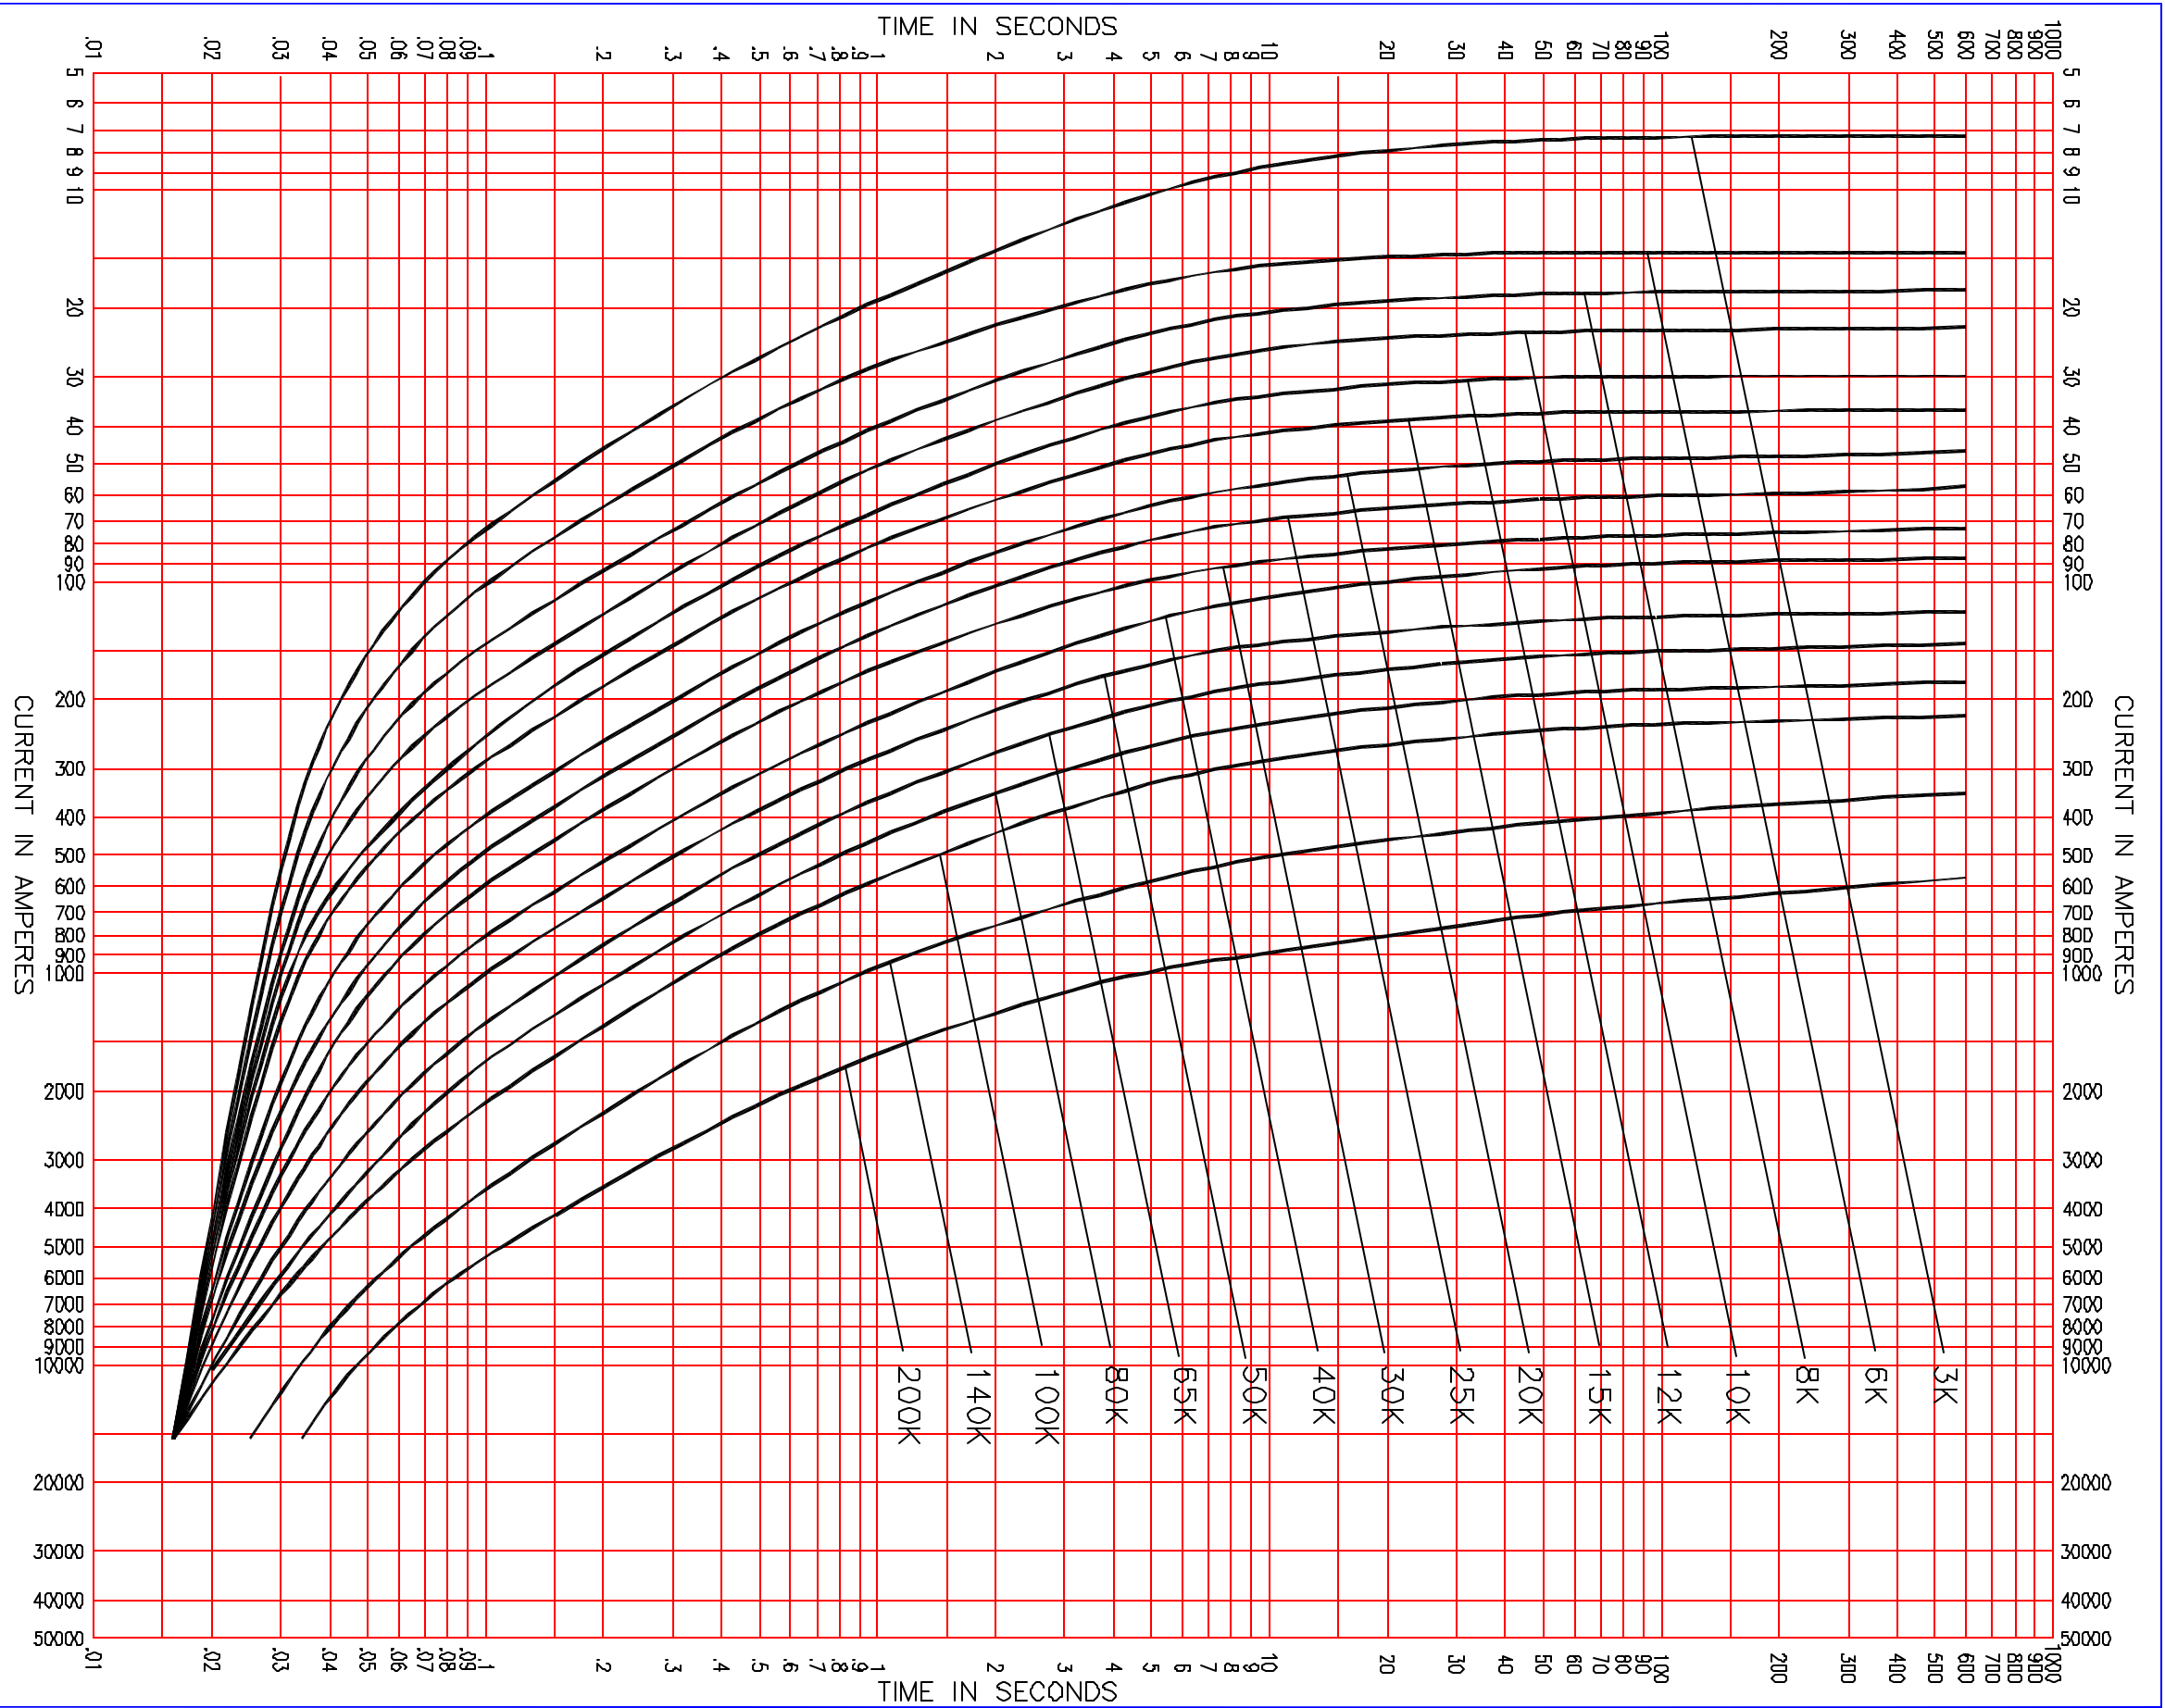

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT						TIME—CURRENT CHARACTERISTICS CURVES											
DRAWN BY CSR						CHK'D						27kV & 38kV TOTAL CLEAR K SPEED CMU 703XXX & CMU704XXX FUSES					
DATE 03/24/05						DATE						Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load					
REPLACES 06/01			REV 02			REQ NO.			Standards used as basis for data: IEEE 37.41–1994 & ANSI C37.42–1981(R1992)								
DWG NO. 42			39836			B			00			MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS					
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.																	