


COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY RJC CHK'D
DATE 4-16-96
REPLACES 11/91 REV 01 REG NO. 16566
DWG NO. 42 39033 B 00

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Page 1 of 2
R240-91-3
Reference Date

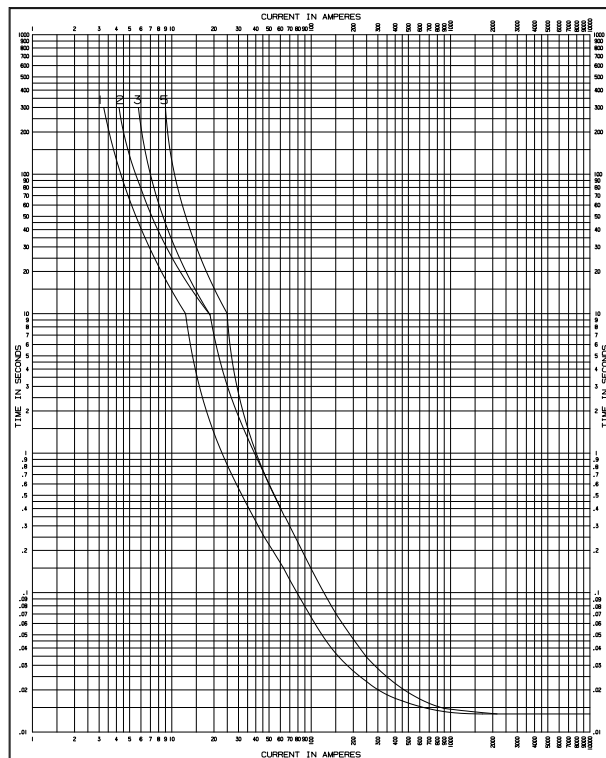

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY RJC CHK'D
DATE 4-16-96
REPLACES 11/91 REV 01 REG NO. 16566
DWG NO. 42 39033 B 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Page 2 of 2
R240-91-3
Reference Date