

COOPER POWER SYSTEMS DIVISION  
COMPONENTS & PROTECTIVE EQUIPMENT


# TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT TIME-CURRENT CHARACTERISTIC CURVES  
4.3kV X-LIMITER FULL RANGE FUSE

DRAWN BY **RJC** CHK'D  
DATE **1-9-96** DATE  
REPLACES **4 / 87** REV **01** REQ. NO.  
DWG NO. **TCC302 M**

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1981  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS  
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-105  
Page 1

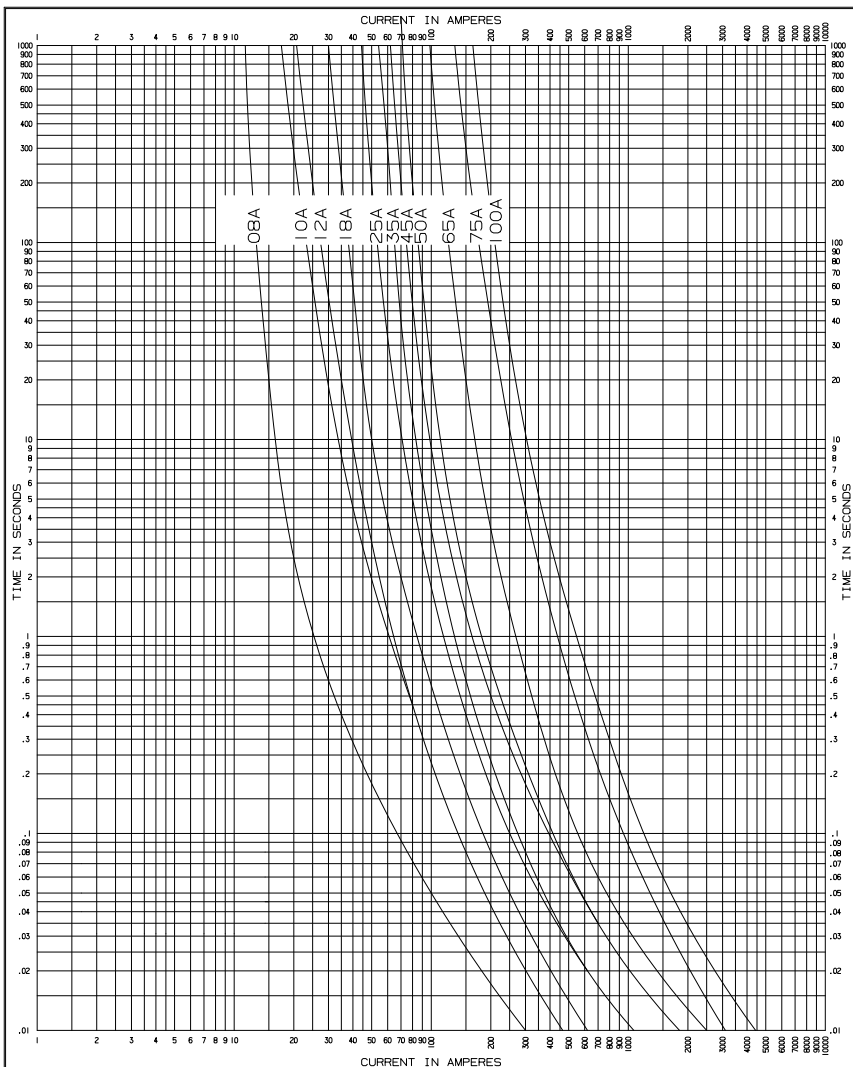

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 4.3kV X-LIMITER FULL RANGE FUSE	
DRAWN BY	RJC	CHK'D	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
DATE	1-10-96	DATE	Standards used as basis for data: ANSI C37.47-1981
REPLACES	4 / 87	REV	01
REQ. NO.			MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
DWG NO.		TCC302 C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
 R240-91-105  
 Page 2