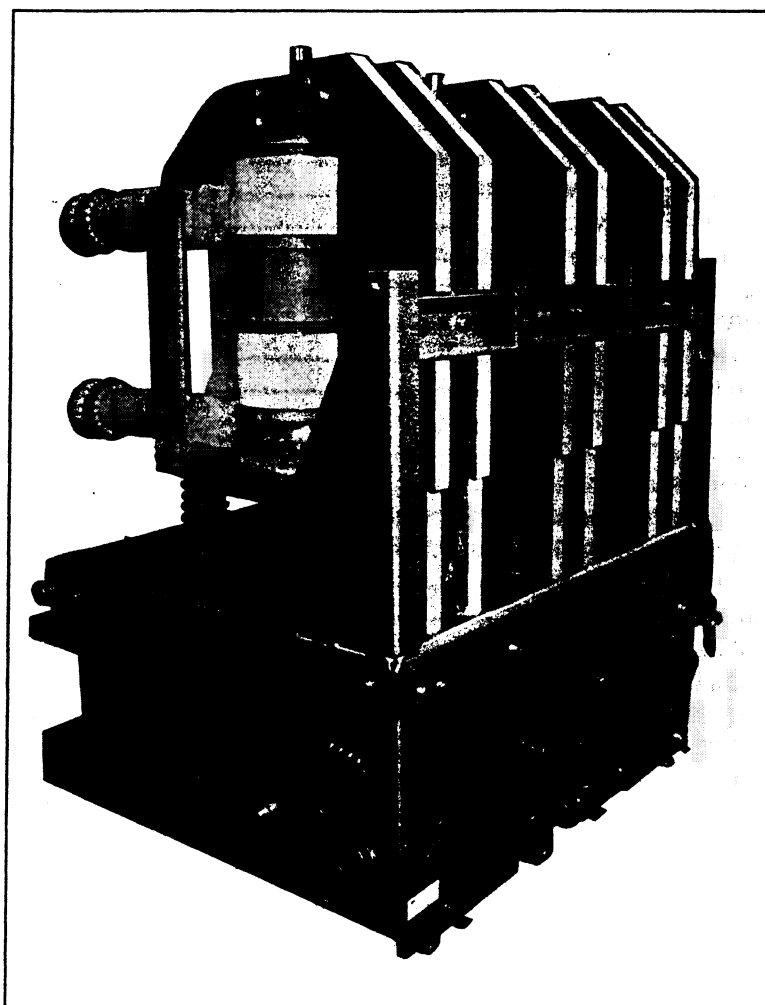


# Installation/Maintenance Instructions

## Medium-Voltage Vacuum Power Circuit Breakers

---

*Type 15VHK1000  
1200, 2000 and 3000 Amperes  
15000 Volts*



**ABB Power Distribution, Inc.  
Circuit Breaker Division**

**ABB**  
ASEA BROWN BOVERI

## **CONTENTS**

	<b>PAGE</b>
<b>INTRODUCTION .....</b>	<b>3</b>
<b>RECEIVING AND STORAGE .....</b>	<b>3</b>
<b>CIRCUIT BREAKER INSTALLATION INFORMATION .....</b>	<b>3</b>
General .....	3
Installation Inspection .....	3
Removing Interphase Barrer .....	3
Removing Front Cover and Interphase Barrier .....	3
Interphase Barrier Examination .....	3
Vacuum Interrupter Examination .....	5
Insulation Structure .....	4
Installing Front Cover and Interphase Barrier .....	5
Installing Circuit Breaker into Compartment .....	5
<b>CIRCUIT BREAKER REMOVAL .....</b>	<b>5</b>
<b>MAINTENANCE AND ADJUSTMENTS .....</b>	<b>6</b>
General Information .....	6
Erosion Indicator Check .....	6
Millivolt Drop Test .....	6
Insulation Cleaning .....	7
Circuit Breaker Operation and Contacts .....	7
Closing and Opening Times and Speeds .....	9
Operating Mechanism .....	9
Racking Mechanism .....	9
Control Relay Adjustment .....	9
<b>LUBRICATION .....</b>	<b>9</b>
<b>DIELECTRIC TESTS .....</b>	<b>10</b>
<b>ELECTRICAL CHARATERISTICS .....</b>	<b>11</b>
<b>ELECTRICAL OPERATING SEQUENCE .....</b>	<b>11</b>
<b>RENEWAL PARTS .....</b>	<b>11</b>
<b>TYPICAL CONTROL CIRCUIT .....</b>	<b>12</b>

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise

AMERICAN ELECTRIC POWER SERVICE CORP.

1 Riverside Plaza  
Columbus, OH 43215

SHEET 1 OF 1


DATE 1-22-92 BY EBF CK.

COMPANY G.O.

PLANT Clayton Hydro

SUBJECT

Clayton Hydro 138/69/34.5/11KV

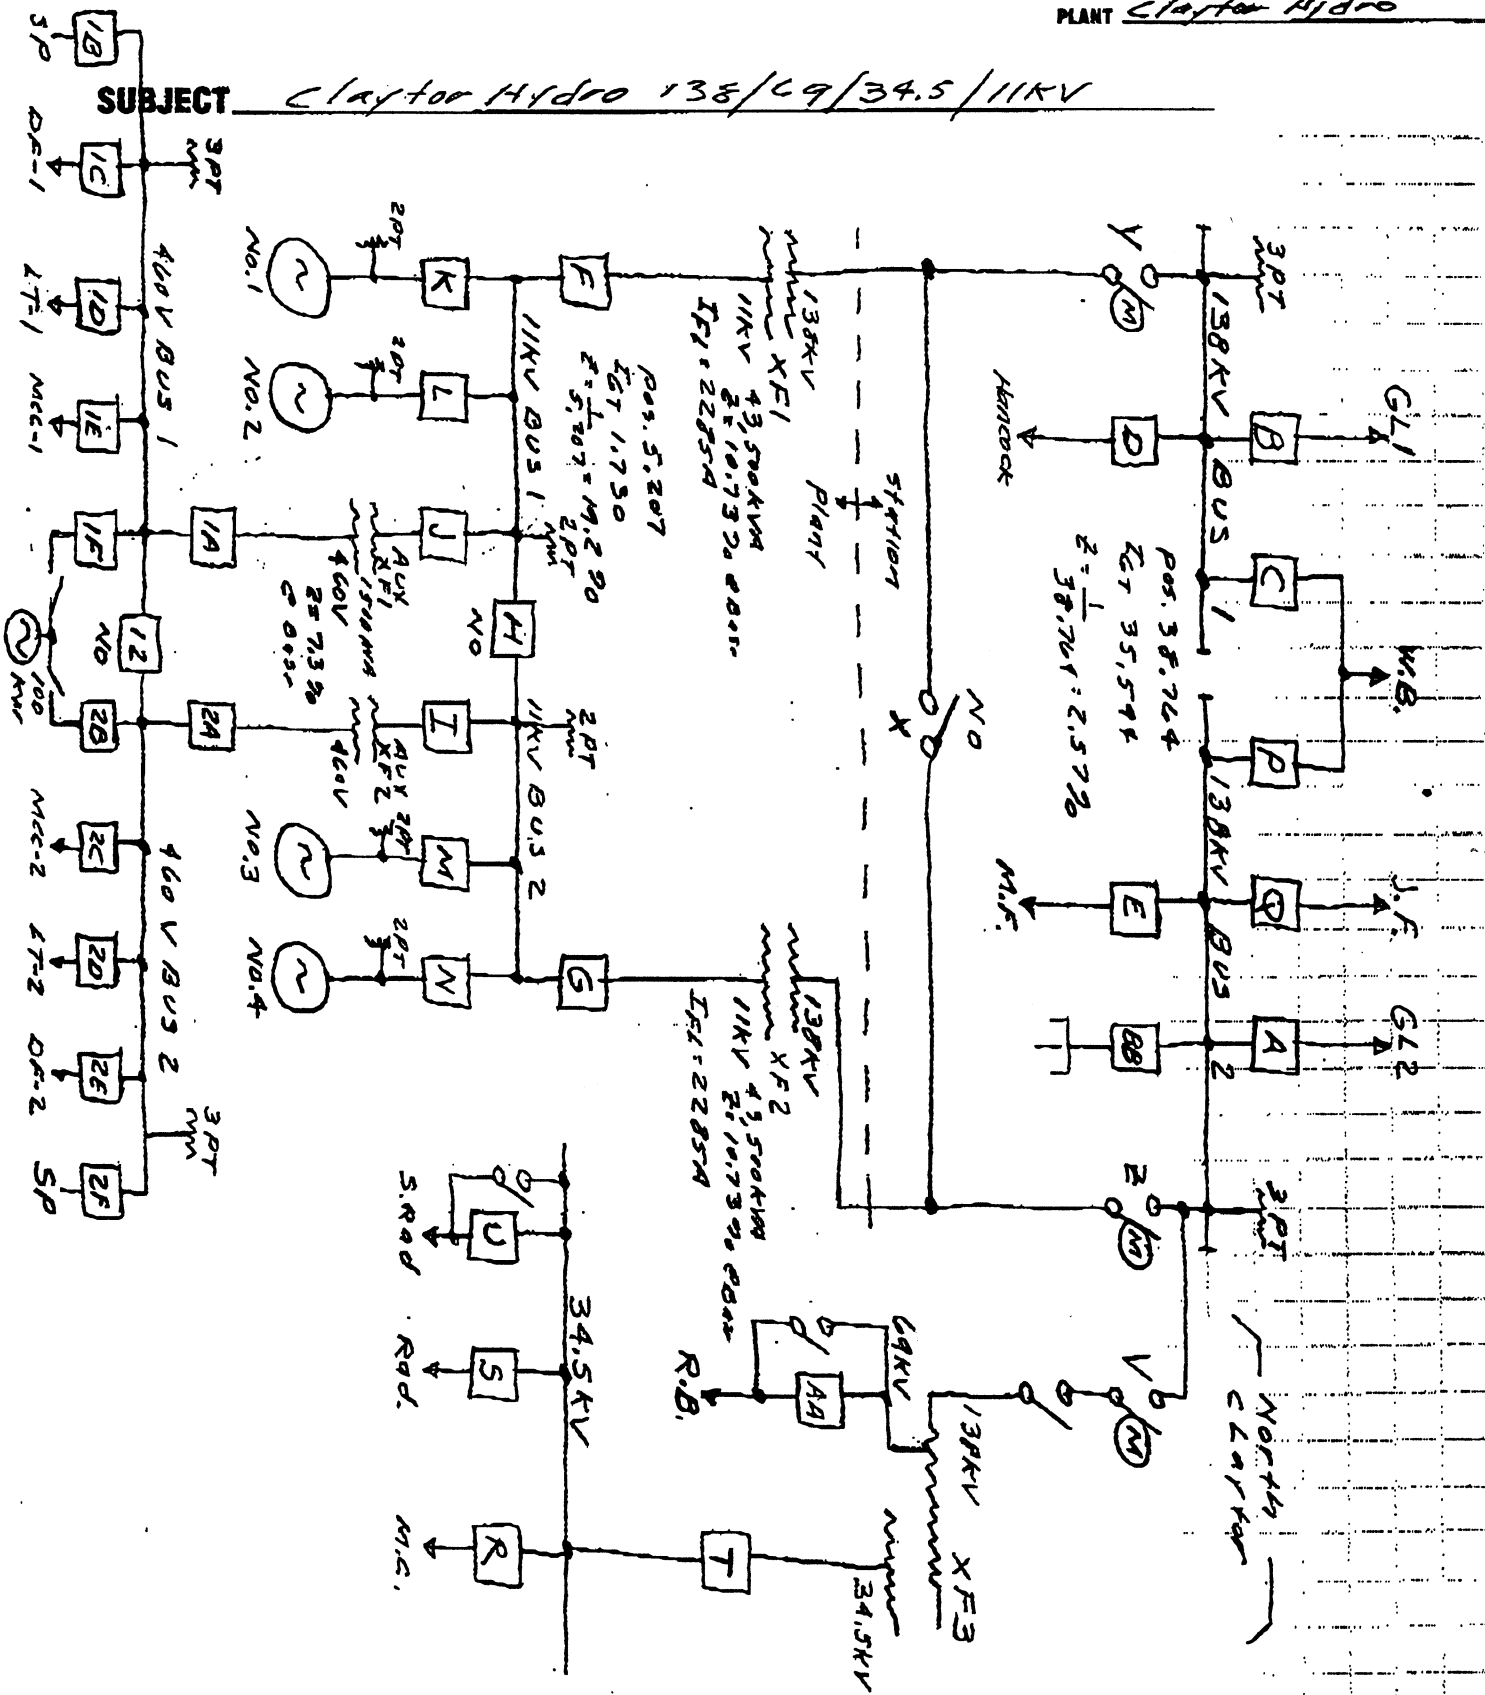

## INTRODUCTION

These instructions for installation, operation and maintenance of 15VHK1000 vacuum circuit breakers should be read carefully and used as a guide during installation and initial operation.

The specific ratings of each model circuit breaker are listed on the individual nameplates.

File these instructions in a readily accessible place together with drawings and descriptive data of the switchgear. These instructions should be used as a guide to proper maintenance of the equipment.

## RECEIVING AND STORAGE

Immediately upon receipt of the circuit breakers, examine the cartons to determine if any damage or loss was sustained during transit. If injury or rough handling is evident, file a damage claim at once with the carrier and promptly notify the nearest ABB Office. The company is not responsible for damage of goods after delivery to the carrier, however, we will lend assistance if notified of claims.

Unpack the circuit breakers as soon as possible after receipt. If unpacking is delayed, difficulty may be experienced in making a claim for damages not evident upon receipt. Use care in unpacking in order to avoid damaging any of the circuit breaker parts. Check the contents of each carton against the packing list before discarding any packing material. If any shortage of material is discovered, promptly notify the nearest District Office. Information specifying the purchase order number and part numbers of the damaged or missing parts should accompany the claim.

Circuit breakers should be installed in their permanent location as soon as possible. If the breakers are not to be placed in service for some time, it is advisable to provide adequate means of protection. This may be done by keeping the breaker in its original shipping carton and storing in a warm, dry and uncontaminated atmosphere. If the circuit breaker cannot be stored properly as recommended it must be thoroughly checked before going into service to insure it has not absorbed moisture, rusted or become generally contaminated in any way.

## CIRCUIT BREAKER INSTALLATION

### General

Prior to initial installation of the circuit breaker into the switchboard, certain preliminary inspections should be made to insure proper operation. The inspection procedures for this are given in this section.

The circuit breaker is shipped with contacts closed,

closing springs discharged and opening springs charged. If the circuit breaker is furnished with an undervoltage device, the device will be lockwired to allow closing of the breaker for shipment. A tag will identify the lock wire. To remove the wire, open the breaker and reach behind the control panel from the right hand side. Using wire cutters, cut and remove the tagged wire.

### WARNING WARNING WARNING WARNING

Prior to any disassembly or inspection of the circuit breaker, the closing springs should be discharged, and the breaker should be open.

Referring to Fig. 1, if it is necessary to raise or move the breaker, attach a lifting yoke (5) at points (4) on both sides of the truck, or a fifth wheel at point (6) to transport the breaker as required.

### Installation Inspection

Inspect condition of circuit breaker vacuum interrupters and electrical connections prior to installing the circuit breaker into the switchboard. Even though each circuit breaker is completely adjusted and tested at the factory, shipping and handling conditions could cause defects. The front cover and interphase barriers (2 & 3, Fig. 1) must be removed for access to and inspection of the vacuum interrupters, and their associated adjustments.

### Removing Front Cover and Interphase Barrier (See Fig. 1)

The front cover can be removed after removing eight front cover screws (1). The interphase barriers can be removed by removing screw (7) from each barrier at the front and two sets of spacer bushings at the rear top and bottom of the barriers. The spacer bushings are retained by hairpin retainers (8) on each end of spacer bushing rods.

### Interphase Barrier Examination

All barrier hardware should be securely tightened. There should be no through holes or apparent missing hardware on the barriers. Also, dust or dirt should be removed by wiping with a clean lintless cloth saturated with an oil-free solvent.

### Vacuum Interrupter Examination (See Fig. 2)

### CAUTION CAUTION CAUTION CAUTION

After the interphase barriers have been removed, a grounding stick should be used to discharge the mid-band ring, on the vacuum interrupters (1), so equipped before any work is done on the interrupters.

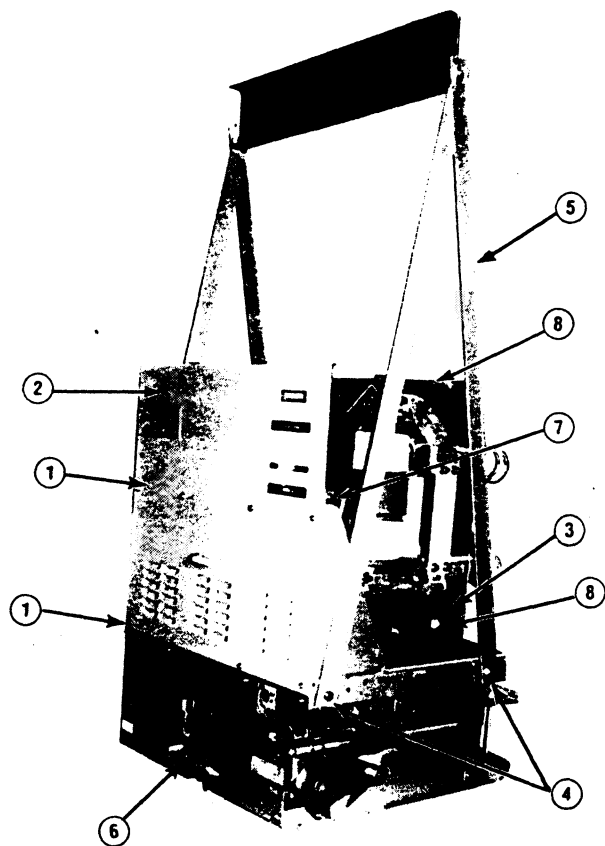


Fig. 1 — Circuit Breaker Assembly with Lifting Yoke Installed

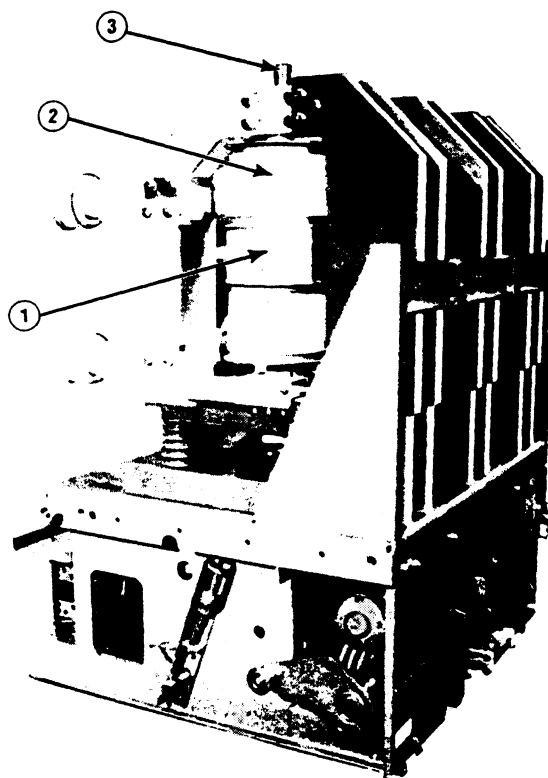


Fig. 2 — Circuit Breaker with Front Cover & Interphase Barrier Assembly Removed

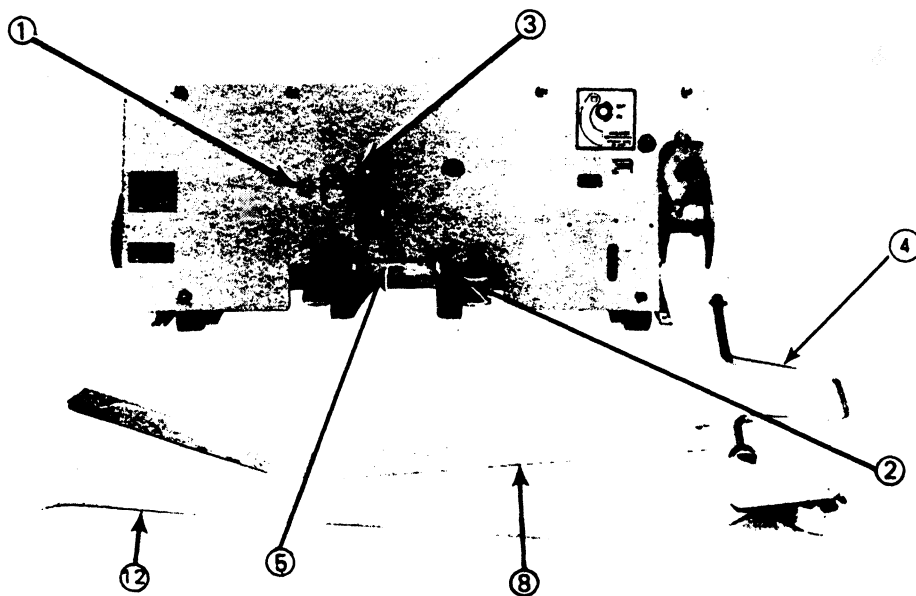


Fig. 3 — Front Circuit Breaker Panel & Accessories

The insulated vacuum envelope (2) should be examined carefully for cracks in the area of the metal-to-insulation seals on both ends and around the mid-band ring. Since a certain amount of transmitted light is usually required to detect cracks, the inspection should be done in a well lighted area. If the mid-band ring, when so equipped, has been bent by an accidental impact, that area should be specially scrutinized for seal damage. Small external chips, however, will not impair the useful life of the interrupter.

To prevent loss of vacuum care should be exercised so as not to damage the interrupter's plastic cover vacuum Pinch-off tube (3).

### Insulation Structure

All insulated parts should be checked for damage. Any dust or dirt should be removed by air or wiped with a clean lintless cloth saturated with an oil-free solvent. This is important because dirt and dust can accumulate and, with moisture, can place the circuit breaker in jeopardy, dielectrically.

### Installing Front Cover and Interphase Barriers (See Fig. 1)

Install the interphase barriers first with one screw (7) for each barrier. Next install the front cover and fasten with eight front cover screws(1).

**NOTE:** It is recommended that a dielectric withstand test be made prior to initially putting this or any type vacuum circuit breaker into service. Refer to Dielectric Tests, in the Maintenance, Adjustments and Tests section of this bulletin, for the correct test procedure.

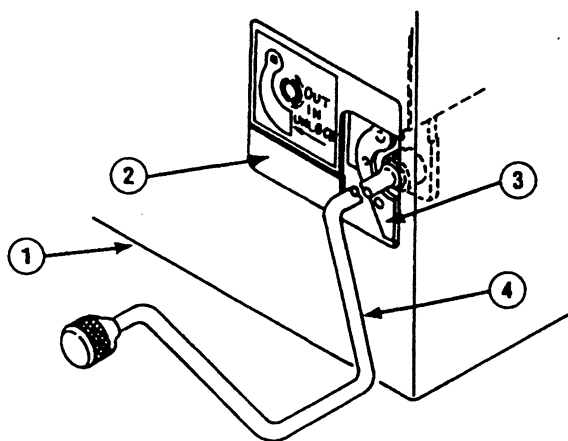


Fig. 4 — Method of Racking Circuit Breaker  
Installing Circuit Breaker into Compartment (See Figs. 3&4)

**NOTE:** CLOCKWISE ROTATION of racking crank for inserting breaker. COUNTERCLOCKWISE rotation of

racking crank for removal of breaker.

Turn motor disconnect switch (1, Fig. 3) to "OFF" position.

Engage racking crank (4, Fig. 4) and push racking unlocking lever (3) to left, then rotate racking crank counterclockwise only until resistance to motion is felt (DO NOT FORCE). If closing springs were left in the "charged" condition, they will automatically discharge.

For installing the circuit breaker into the lower compartment, the fifth wheel is used to position the breaker so that it is lined up with the switchgear. Engage the fifth wheel (12, Fig. 3) with hole (5, Fig. 3). The lift device is required to lift and position the breaker for installation into the upper compartment. Guide and push circuit breaker into compartment until stopped. Again engage racking crank and rotate clockwise until racking mechanism automatically stops at "DISCONNECT" position. (Breaker is now held captive in compartment.)

To rack circuit breaker to "TEST" position, push racking unlocking lever (3, Fig. 4) to left, rotate racking crank approximately 1/4 turn clockwise, then release unlocking lever. Continue cranking until racking mechanism automatically stops at "TEST" position.

With the circuit breaker racked to "TEST" position, it should be checked for proper operation by operating all possible means of opening and closing, this includes control switches, relays, etc. Turn motor disconnect switch (1, Fig. 3) to "ON" position to charge the closing springs, and operate the breaker as required.

### WARNING WARNING WARNING WARNING

When racking circuit breaker to "CONNECTED" position, close compartment door (1, Fig. 4) and insert racking crank (4, Fig. 4) through sliding panel (2, Fig. 4).

Push unlocking lever (3) to left and turn racking crank (4) approximately 1/4 turn clockwise, then release unlocking lever. Continue cranking until racking mechanism automatically stops at "CONNECTED" position.

### CAUTION CAUTION CAUTION CAUTION

Do not attempt to rack any further.

The circuit breaker may now be put in service and be operated as required.

### CIRCUITBREAKER REMOVAL(SeeFig.4)

To remove circuit breaker from "CONNECTED" position, open the breaker as required.

Open sliding door (2) in front compartment door (1). Engage racking crank (4) and push racking unlocking lever (3) to left. Rotate racking crank (4) counterclock-

wise approximately 1/4 turn, then release unlocking lever. Continue cranking counterclockwise until racking mechanism automatically stops at "TEST" position. Repeat same operation for "DISCONNECT" position. The circuit breaker can now be positioned for withdrawal. If in the upper compartment (1200 and 2000A breakers) the lift device must first be located in the correct position. For withdrawal from the switchboard, again push the racking unlocking lever to the left and turn the racking crank counterclockwise only until resistance to motion is felt. (Approximately 2-3 turns - DO NOT FORCE ) The closing springs, if charged, will automatically discharge when the circuit breaker is moved to the withdrawn position. The circuit breaker can now be removed from the compartment by pulling on the handle located on the front barrier.

## MAINTENANCE, ADJUSTMENTS AND TESTS

### General Information

The 15VHK1000 circuit breakers are designed for minimum maintenance and tested to insure that minimum maintenance will be required. The few adjustments that are noted are required only when an operational check indicates a problem. Of course, during the maintenance checks, all accessible bolts, nuts and screws should be routinely checked to insure that they are tight.

It is recommended that the circuit breaker be normally inspected after the first 1000 operations, regardless of the type of duty it is used for. These operations can be either no-load mechanical, load current switching, capacitor or reactor switching operations, or for motor starting applications.

Vacuum interrupters, as used on the 15VHK1000 circuit breakers, have an inherently long contact life and will provide trouble-free service under varied application conditions, as long as the circuit breaker is applied within its rating. The wear condition of the individual vacuum interrupters will vary, depending on circuit conditions and such variables as single phase versus three-phase interruption, X/R ratio (asymmetry) and relay delay times. Of course, interrupting high short-circuit current will cause contact erosion to occur faster than load current interruptions. The interrupters for the 15VHK1000 Circuit Breakers have been tested for 2000% KSI minimum. It is unlikely that a circuit breaker will be subjected to this much duty during the life of the breaker and it is not expected that the interrupters will have to be replaced due to excessive erosion of contacts. However an erosion indicator is incorporated and the remaining erosion can be checked during maintenance. For the check on contact erosion, see section "Erosion Indicator Check".

If, however after the first inspection period there is no indication of any problems, actual operating experience with specific circuits will indicate the future amount of maintenance needed for the various circuit breakers and the procedure can be modified as required.

Of course, where unusual service conditions exist, as covered by ANSI Standard C37.04, it must be presumed that these conditions were considered at the time of order; that the equipment supplied was designed for the special application; and that an appropriate supplemental maintenance program has been developed. These maintenance instructions only cover circuit breakers used under the standard service conditions.

At the selected maintenance period, the following tests and adjustments should be made:

**NOTE:** The following tabulated tests and adjustments are all that are normally necessary for proper maintenance and operation of the 15VHK1000 circuit breaker. The remaining portions of the breaker — close coil assembly, shunt trip device, control relay, auxiliary switch and motor — require no maintenance during the standard life of the circuit breaker regardless of the operating duty.

### Erosion Indicator Check

An erosion indicator is provided on each interrupter to show contact wear or erosion. The erosion indicator consists of a red line painted on the stem of the moving contact. As the contacts erode, the stem moves up further, and the distance between the bottom of the vacuum bottle and the red mark is decreased. When the top edge of the red marking reaches the bottom of the vacuum bottle it is recommended that the interrupter be replaced. It is noted that there is no "half-life" adjustment required because the contact springs provide sufficient pressure through the entire wear allowable.

### D.C. Millivolt Drop Test

During maintenance periods, the condition of the breaker current circuit can easily be determined by performing a millivolt drop test. This test should be performed regardless of whether the circuit breaker had interrupted low or high currents or has minimum operations.

The following table lists the millivolt drop and resistance values for the circuit breakers covered by this instruction book from terminal to terminal, exclusive of the primary disconnects.

Circuit Breaker	Maximum MV Drop*	Maximum Micro-Ohms
15 VHK1000, 1200 Ampere	6.5	32.5
15 VHK1000, 2000 Ampere	5.5	27.5
15 VHK1000, 3000 Ampere	5.0	25.0
Millivolt drop with 200 amperes DC flowing.		

### Insulation Cleaning

Any dirt, dust or grease should be removed from the surfaces of the entire current carrying structure, vacuum interrupter\*, base insulation sheet and interphase barrier assembly. Wiping the surface with an oil-free solvent on a clean cloth or industrial wiper is normally sufficient for this purpose.

\*Remember to discharge mid-band ring on interrupters.

### CIRCUIT BREAKER OPERATION AND CONTACTS

1. To check breaker operation, the breaker should be withdrawn from the switchboard, the front cover and barrier removed and the racking screw turned two to three turns clockwise until the racking unlocking lever snaps into the first position corresponding to the disconnect position.

2. Fully closed breaker (See Fig. 3). Charge the closing springs and turn the motor switch (1) off. Close the breaker. Engage manual charge handle (8) with charging lever (3). During the initial portion of the downward stroke of the handle check to see which direction the closing spring guides (2) move. If this spring guides start to move out then the breaker did not fully close. If the spring guide begins to move in and with additional pumping moves in until the mechanism can be heard to "snap in", then the breaker did not fully close originally. Excess contact pressure or friction can cause this condition and if it cannot be relieved then the factory should be consulted.

3. Contact wipe (contact pressure) (See Fig. 5). The contact air gap and contact wipe is set at the factory by setting the vertical position of the interrupter (1) and the vertical position of the pushrod (2). The parts should not be repositioned in the field unless a pushrod change is required to correct contact sequence as described elsewhere. Contact erosion and wear in mechanical parts will cause a reduction in contact wipe over the life of the breaker. For a check on contact erosion, see section "Erosion Indicator Check".

4. Contact Air Gap (See Fig. 5). The contact air gap is set at the factory at the nominal dimension of .35. This value will normally increase as the contacts erode. A check of the contact air gap checks that the breaker does open

fully and that the gap is sufficient to withstand the applied voltage. The measurement is made as follows for the three poles.

- Open the breaker and discharge the closing springs.
- Measure and record dim. Y<sub>2</sub>.
- Close the breaker, measure and record dim. Y<sub>1</sub>.
- The air gap is the difference between the two measurements. The acceptable limits are .30 — .50, with the upper limit being approached as contact wipe approaches the minimum.

5. Contact sequence (See Fig. 5). All three poles should touch within 2 millisecond at normal closing speeds. An oscilloscope, oscillograph or other timing method may be used to establish the 2 millisecond timing.

Before checking contact sequence, check that the contact wipe and air gaps are correct. It is not expected that the contact sequence should exceed the 2 millisecond limit; therefore, before attempting to readjust, check that the test equipment and procedure are correct. Also consider, especially when testing with electronic equipment, that .002 seconds vacuum interrupter contact bounce is permissible during normal closing and this bounce can influence the contact touch measurements. If it is determined that the contact sequence is not within the 2 milliseconds, then adjustment is required. Usually, readjustment of one pole should be sufficient so that all three poles touch within 2 milliseconds. The air gap of the pole to be changed should be decreased if the contacts of that pole are touching after the other two poles, or increased if the contacts are touching before the other two poles. The air gap is decreased by turning pushrod (2) clockwise, viewing from the top of the breaker, and increased by turning counterclockwise.

Before the pushrod can be turned, the breaker must be open, closing springs discharged and pin (3) removed. With the breaker open, the vacuum in the interrupter maintains a constant upward force of approx. 25 lbs. on the moving contact and pushrod (2). Therefore, before removing pin (3), the contact must be held down in the open position by temporary spacers at location (z). After removing retaining ring (4) and pin (3), rotate pushrod (2) as required. 1/4 turn of the pushrod (2) will change the air gap by approx. .019. After rotating the pushrod, carefully reposition the moving contact and pushrod vertically to align the pin holes. Replace the pin and retainer and remove the temporary spacer. During the readjustment procedure note that the contact wipe and air gap dimensions, specified previously, must be maintained. Also, that no more than 1/2 turn total of the pushrod should be required when readjusting for contact sequence.

After completing the contact sequence procedure, recheck the contact wipe and air gaps.



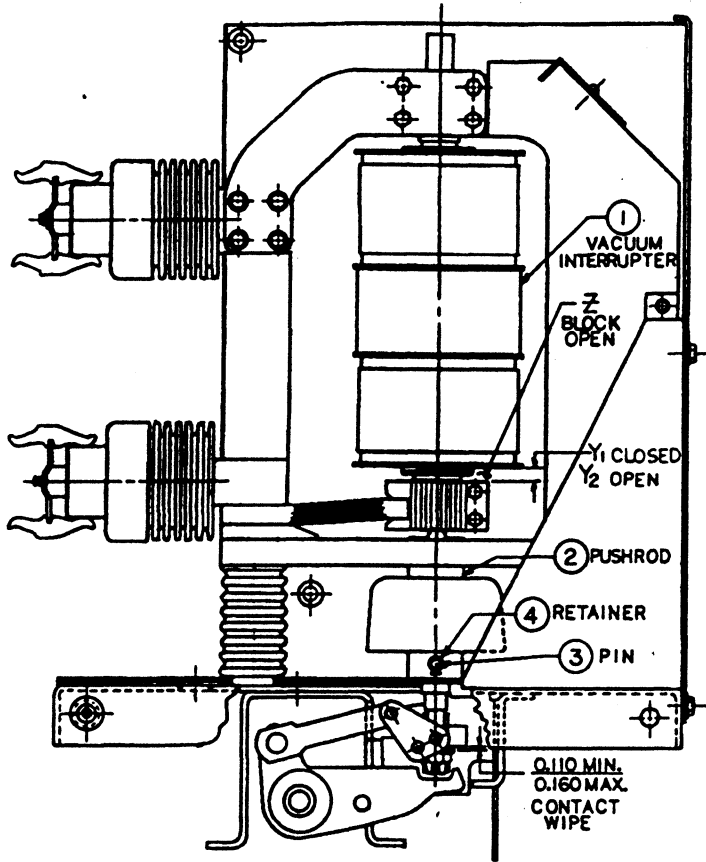


Fig. 5 — Contact Pressure

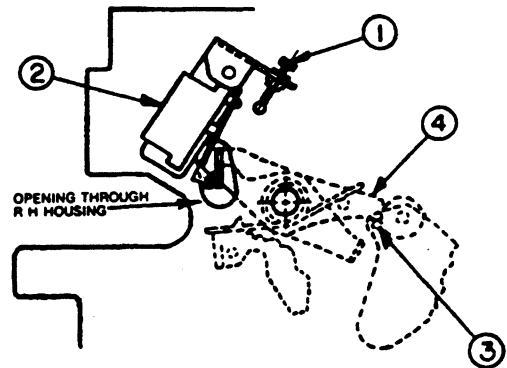


Fig. 6 — Latch Check Switch Adjustment

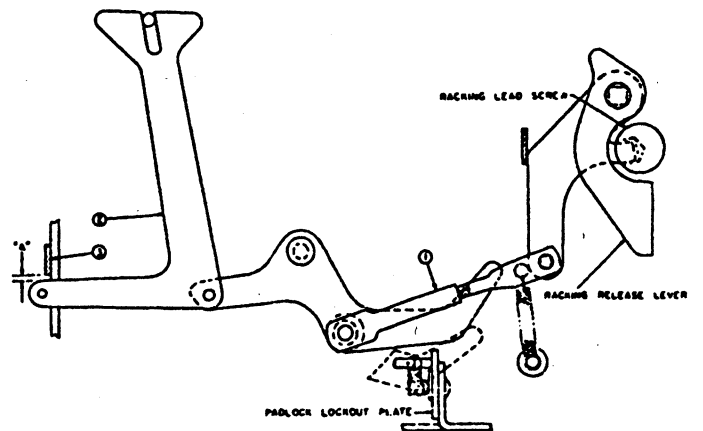


Fig. 7 — Racking Mechanism

The front cover and interphase barriers can now be reinstalled. Return the racking screw to its original position by turning it counterclockwise approx. two to three turns until it stops.

### Closing and Opening Times and Speeds

After the operation intervals noted previously, the closing and opening times are recommended to be checked by use of a cycle counter, travel recorder, oscillograph, etc. to monitor the time from energizing to contacts touch or part.

\*A potentiometer with mounting support, used in conjunction with an oscilloscope or oscillograph, and instructions are available on special order for specifically checking opening and closing speeds.

The circuit breaker closing and opening times should be within the following time ranges for normal operation.

Closing Time Range — MS	Opening Time Range — MS
40-60	25-35

### NOTES:

1. Below 0°C, the closing times will increase (but with no reduction in closing force); and opening times will be within the limits.

2. Adjustments to correct speeds, if found to be outside limits, are critical and the nearest District Office should be contacted for recommendations.

### Operating Mechanism (See Fig. 6)

The operating mechanism is adjusted at the factory for proper operation and should not be disturbed unless the circuit breaker does not close electrically on reclosing duty.

This condition is caused when the latch check switch (when used) is not actuated. Circuit breaker should not close before trip latch (4) has reset.

Adjustments should be made with latch (4) against reset stop pin (3). Turn in adjusting screw (1) until contacts of switch (2) "break" (as indicated by an audible click or check with bell ringer). Retract adjusting screw until switch contacts "make", then rotate adjusting screw one turn more. (Adjusting screw is self-locking.)

### Racking Mechanism (See Fig. 7)

The circuit breaker racking mechanism is adjusted for proper operation and should not be disturbed unless it becomes possible to close the breaker during a racking operation.

It may be possible that interlocked blocking members are not positioned properly, which should be corrected as follows:

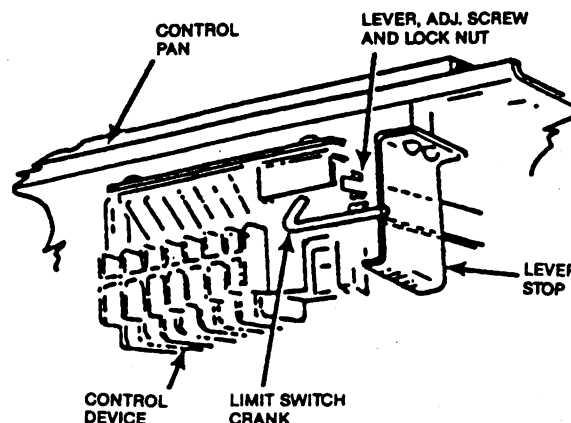


Fig 8 - Control Relay

Remove the lower front mechanism coverplate and with the circuit breaker closed, make adjustments by regulating the length of connecting rod (1) for 1/32 inch minimum to 3/32 inch maximum clearance of "A" between trip link (3) and blocking lever (2). The maximum adjustment at point "A" should not exceed 3/32 inch.

### Control Relay Adjustment (See Fig. 8)

The control relay does not normally require any adjustment in the field. However, if necessary adjust the gap between the control device lever adjusting screw and the limit switch crank arm for a 1/64—1/32 gap with the closing springs charged. With the closing springs discharged, the gap between the lever stop and the lever should be 1/64" to 1/16".

### LUBRICATION

The 15VHK1000 circuit breakers are lubricated during factory assembly as follows:

1. All mechanism parts, bearings, pins, etc., have been lubricated with Anderol 757 manufactured by Nuodex, Inc. (formerly Tenneco Chemical, Inc.). (ABB No. 712994A, 4 oz. tube).

If the grease should become contaminated or unduly oxidized (hardened and darkened) or if parts are replaced, any relubrication should be done with the lubricants noted.

### NOTES:

1. The mechanism should be periodically inspected for lubrication contamination; frequency of inspection is dependent on operating environment.

2. Do not use light oil to lubricate any mechanism parts. In emergency situations, Anderol 732 may be used as a temporary lubricant. In these cases, allow time for the

solvents to evaporate prior to any mechanical operations. It is mandatory that the breaker undergo thorough lubrication with Anderol 757 at the next maintenance interval. Use of solvents to free contaminated lubricant is strictly forbidden without immediate relubrication using Anderol 757. Note that bearing surfaces must be re-packed and this will require disassembly of the mechanism. Do not operate the circuit breaker without completing this procedure.

3. The charging motor is sealed and no lubrication is required.

### DIELECTRIC TESTS

It is recommended that dielectric withstand tests be made prior to use and then at routine maintenance periods to verify the integrity of vacuum interrupters. If, during the dielectric withstand test, the required test voltage cannot be sustained across the open contacts of the vacuum interrupter, the interrupter is faulty and must be replaced. Always insure that the contact air gap is correct before conducting primary circuit dielectric tests.

#### CAUTION CAUTION CAUTION CAUTION

While the procedure for dielectric testing a vacuum breaker is similar to that for any other type breaker, there are two areas which require extra CAUTION in handling.

1. The internal shield of a vacuum interrupter can acquire an electrical charge which is usually retained even after the voltage is removed. On certain types of interrupters, this shield is attached to the exposed mid-band ring and a grounding stick should be used to discharge the ring before working on the device.

2. Dielectric test voltages higher than rated voltage,

applied across open contacts, may cause a vacuum interrupter to emit some X-radiation which could be a health hazard on prolonged exposure at close range. Accordingly, even though the emission is low and on for such a short period of time, it is considered appropriate to exercise caution.

Therefore, do not run any primary circuit dielectric withstand tests on isolated interrupters with open contacts, above rated voltage unless test personnel are adequately shielded or they are no less than six feet from the test unit.

Regarding complete breakers, it is noted that NO hazardous X-radiation is produced with closed contacts at any test voltage or with open contacts at rated voltage and there should be no cause for concern. Further, if the breaker is tested in its switchgear compartment, the enclosure steel provides sufficient shielding to protect personnel from X-radiation at the test voltages recommended below at the normal distances maintained for electrical safety.

The following test values should be used for dielectric testing the complete breaker and are to be applied for a one-minute period.

DIELECTRIC TESTS	60Hz
Primary Circuit	36.0kV
Secondary Circuit (Control)	1100Vk

\* If it is desired to make a dielectric test on the secondary control wiring, turn the spring charging motor disconnect switch (1, Fig. 3) to the "OFF" position. Apply test voltage (1100V-AC ) for one minute to each of the secondary

TABLE 1 — OPERATING VOLTAGE RANGE

				Undervoltage	
Nominal Control Voltage	Spring Charging Motor	Close Coil	Trip Coil	Pick-up Maximum	Drop-out
24 V dc	—	19-28	14-28	21	7-14
48 V dc	38-56	38-56	28-56	41	15-29
125 V dc	100-140	100-140	70-140	105	38-75
250 V dc	200-280	200-280	140-280	212	75-15
120 V ac	104-127	104-127	104-127	102	36-72
240 V ac	208-254	208-254	208-254	204	74-144

disconnect contacts at the rear of the circuit breaker. If it is desired to make a dielectric test on the spring charging motor, turn the motor disconnect switch (1, Fig. 3) to the "ON" position. Apply test voltage (540V-AC) for one minute to the motor circuit.

### ELECTRICAL CHARACTERISTICS OF CONTROL DEVICES

For operating voltage ranges for various nominal control voltages, refer to Table 1.

For average current values at various nominal control voltages, refer to Table 2. The current values given in this table are average steady state values - momentary inrush currents for all charging motors and AC coils are approximately six to eight times these values.

### ELECTRICAL OPERATING SEQUENCE

Please refer to the specific schematic diagrams and other operational information furnished with your order. Fig. 9 is provided as a typical schematic for general information on electrical operation.


### RENEWAL PARTS

We recommend only those renewal parts be stocked that will be required to insure proper and timely maintenance for normal operation of the 15VHK1000 circuit breakers. Copies of the applicable Renewal Parts Bulletin for specific circuit breakers will be furnished on request to the nearest District Office.

The minimum quantity of assemblies and items recommended in these bulletins are predicated on infrequent replacement of parts based on accumulated tests and operating experience. Total assemblies are recommended for fast replacement, when necessary, to return the breaker to service as quickly as possible. Then certain replaced assemblies can be returned to the factory for nominal reconditioning. The bulletins contain specific part ordering instructions, and if desired, specific instructions regarding replacement of those part assemblies recommended, that are not obvious, are also available if ordered.

Figure 2 - Average Currents Values

Nominal Control Voltage	Control Charging Motor	Close Coil	Trip Coil	Lockout Coil	Under Voltage	N.E.C. Fuse
24 V dc	-	22.0	22.0	0.30	0.9	30
48 V dc	25.0	10.7	10.7	0.15	0.5	30
125 V dc	10.0	5.0	5.0	0.06	0.2	30
250 V dc	5.0	2.2	2.2	0.03	0.1	30
120 V ac	10.0	4.5	4.5	0.40	0.2	30
240 V ac	5.0	2.3	2.3	0.20	0.1	30



### REAR VIEW OF SECONDARY DISCONNECTS

### LEGEND

- a — Auxiliary Switch Contact Closed When Breaker Is Closed.
- b — Auxiliary Switch Contact Open When Breaker Is Closed.
- LSa — Limit Switch Contact Open When Springs Are Discharged. Closed When Springs Are Charged.
- LSb — Limit Switch Contact Closed When Springs Are Discharged. Open When Springs Are Charged.
- TC — Shunt Trip Coil.
- X — Closing Latch Release Coil.
- Y — Control Relay Lockout Coil.
- Ya — Normally Open Control Relay Contact.
- Yb — Normally Closed Control Relay Contact.
- TB — Terminal Block Point.
- ML — Motor Lead.
- CE — Coil Lead End.
- C1, C2 — Terminal Jumper (Control Device).
- — Female Secondary Disconnect Contact.

**Fig. 9 — Typical DC Schematic Diagram of Control Circuit**