

MPU-16A

A-B PROTOCOL/DATA LOGGER MANUAL

JUNE 12, 2002

PRELIMINARY

Copyright © 2002 by Startco Engineering Ltd.
All rights reserved.



TABLE OF CONTENTS

| | PAGE |
|--|------|
| 1. Computer Interface Description..... | 1 |
| 2. Software Protocol Description..... | 1 |
| 3. MPU-Specific Information | 1 |
| 3.1 Command Format (CMD) | 1 |
| 3.2 Data Base | 2 |
| 3.2.1 Set Point Memory..... | 2 |
| 3.2.2 Display Memory | 2 |
| 3.2.3 Command Memory..... | 3 |
| 3.2.4 Trip-Status-Bit Definitions..... | 3 |
| 3.2.5 Alarm-Status-Bit Definitions..... | 4 |
| 3.2.6 Motor-Status Definitions..... | 4 |
| 4. MPU-16A Data Logging Option | 4 |
| 4.1 Configuration Registers | 4 |
| 4.2 Register Definitions | 4 |
| 4.3 Trigger Description..... | 5 |
| 4.4 Data-Logging Record Format..... | 5 |
| 5. MPU-16A Station-Address Selection..... | 6 |
| 6. Configuration Switches..... | 6 |
| 6.1 Baud Rate | 7 |
| 6.2 Turn-Around Delay..... | 7 |
| 6.3 Error-Check Type | 7 |
| 7. Specifications | 7 |
| 8. Interface Converter | 7 |
| 8.1 Network Interconnection..... | 7 |
| 8.2 RS-485 Termination | 7 |
| 9. PLC-5 Programming..... | 8 |
| 9.1 Channel Configuration..... | 8 |
| 9.2 Message Instruction | 8 |
| 10.2.1 Communication Command..... | 8 |
| 10.2.2 PLC-5 Data Table Address | 8 |
| 10.2.3 Size In Elements | 8 |
| 10.2.4 Local/Remote..... | 9 |
| 10.2.5 Local Node Address | 9 |
| 10.2.6 Destination Data Table Address..... | 9 |
| 10.2.7 Port Number | 9 |
| 9.3 Diagnostics..... | 9 |
| 10. SLC-500 Applications | 10 |
| 10.1 Channel Configuration..... | 10 |
| 10.2 Read Messages | 10 |
| 10.3 Write Messages..... | 10 |

TABLES

| TABLE | PAGE |
|----------------------------------|------|
| 1 STS Status..... | 1 |
| 2 Set Point Memory..... | 2 |
| 3 Display Memory | 3 |
| 4 Command Memory..... | 3 |
| 5 Trip-Status Bits..... | 3 |
| 6 Alarm-Status Bits..... | 4 |
| 7 Motor-Status Bits..... | 4 |
| 8 Configuration Registers..... | 5 |
| 9 Data Logger Record Format..... | 6 |
| 10 Mode-8 Program Options..... | 6 |
| 11 Baud Rate | 7 |
| 12 Turn-Around Delay | 7 |
| 13 Response Delay | 7 |
| 14 Error Checking | 7 |

FIGURES

| FIGURE | PAGE |
|--|------|
| 1 SE-485PP Port Powered RS-232 to RS-485 Converter..... | 11 |

DISCLAIMER

Specifications are subject to change without notice. Startco Engineering Ltd. is not liable for contingent or consequential damages, or for expenses sustained as a result of incorrect application, incorrect adjustment, or a malfunction.



1. COMPUTER INTERFACE DESCRIPTION

The protocol is based on the half-duplex master/slave Allen-Bradley (AB) Data Highway Protocol (DF1) as described in Allen-Bradley Publication 1771-6.5.16 and SCADA Applications Guide Publication CMGI-11.2.

The communication system consists of a single master and up to 30 slaves, connected to a two-wire, multidrop network. The MPU-16A's are the slave devices on this network. The master is an IBM PC/AT, PLC-2 1771-KGM, or equivalent master running the DF1 half-duplex protocol.

The master requires a RS232 to RS485 converter to generate the 2-wire multidrop network. The RS-485 converter should have automatic send-data control (SD). SD control does not require hand-shaking lines since it uses the data line to control the RS-485 transmitter. The RS485 network is connected directly to the MPU-16A slaves via 2-wire cable.

PLC-2 unprotected read (CMD=1) is used to retrieve information from the MPU-16A and PLC-2 unprotected write (CMD=8) is used to make set-point changes and to perform reset functions.

Instructions are compatible with the SLC-500 series, PLC-2, PLC-3, and PLC-5. Because of address limitations, SLC-500 access is limited to set point and display memory. Data-logging information is not accessible.

2. SOFTWARE PROTOCOL DESCRIPTION

For specific details on the AB protocol, refer to AB publication 1770-6.5.16. This publication is recommended for anyone designing a software driver for use with the MPU-16A.

The hexadecimal and octal number system is used in this manual. Value representations use the "C" convention. For hexadecimal, 0x precedes the value and for octal, 0 precedes the value.

3. MPU-SPECIFIC INFORMATION

The MPU-16A serial-port data base is updated every 300 ms. Database values can be read one by one or as a group. Since these values are updated every 300 ms, the master need not read these values any faster than 300 ms. In the case of set point-write or reset commands, only one set point or reset command may be processed every 300 ms.

On a system with multiple MPU's, the throughput of the network can be improved by using the broadcast address in the message. The message is processed simultaneously in all MPU's. The message can be retrieved sequentially from all devices using the POLLING PACKET.

All 16-bit values are transferred with the low byte followed by the high byte.

3.1 COMMAND FORMAT (CMD)

Two commands are supported to read and write values to the MPU-16A.

For a read command (CMD=01), the DATA portion of the master packet contains a 16-bit value for ADDR and an 8-bit value for SIZE. ADDR is the starting address of the database memory and SIZE specifies the number of bytes to transfer. Since all database values are 16 bits, SIZE should always be an even multiple of 2.

NOTE: When using the read or write command with a PLC-2, the data retrieved is in words, which are 16-bit values. The size specification in the PLC refers to the number of words to retrieve. The actual values of ADDR and SIZE will be two times the word values.

For write commands (CMD=08), the DATA portion of the master packet contains two 16-bit values, ADDR and VAL. VAL contains the set-point value or the reset code.

Read Command Master-Packet Format: DLE SOH STN DLE STX DST SRC CMD STS TNS ADDR SIZE DLE ETX CRC/BCC (CMD=01)

Read-Command Slave-Packet Format: DLE STX DST SRC CMD STS TNS DATA DLE ETX CRC/BCC (CMD=41)

Write Command Master-Packet Format: DLE SOH STN DLE STX DST SRC CMD STS TNS ADDR VAL DLE ETX CRC/BCC (CMD=08)

The MPU-16A replies with DLE ACK to this packet and processes the data. The reply message is sent to the output message buffer and is held until the POLLING PACKET is received. The reply message will have CMD equal to 48 and will have the STS equal to 0 if no error occurred.

On an error, a message packet is generated with the error code stored in the STS byte. DLE STX DST SRC CMD STS TNS DLE ETX CRC (CMD=48)

Table 1 lists the error codes supported.

TABLE 1. STS STATUS

| HEX | DESCRIPTION |
|------|----------------------------|
| 0x00 | No error. |
| 0x10 | Illegal command or format. |
| 0x20 | MPU data not available. |
| 0x50 | Invalid ADDR, SIZE or VAL. |



3.2 DATA BASE

3.2.1 SET POINT MEMORY

You can read or write to the set-point memory. The protocol allows individual or groups of set points to be read; however, set points must be written one at a time and only one set point may be changed every 300 ms. See Table 2.

The memory address of the database value (ADDR) is a 16-bit byte pointer that points to the high-order byte of the 16-bit word. The memory-address pointer (ADDR) must always be even. ADDR or ADDR+SIZE should not exceed the set-point memory size.

Set-point memory is organized in 16 bit words. Database values less than 256 will have 0 stored in the high-order byte. Database values are transmitted as two 8-bit bytes, with the low byte transmitted first.

Set-point write instructions must have the data in the 16-bit format. The address (ADDR) must be one of the valid database addresses listed in the table. VAL contains the 16-bit set-point value. Set-point values greater than the delete value are forced to the appropriate delete value. For set points with no delete value, the maximum value of the range is stored. Set-point values below the minimum are forced to the minimum value.

Set-point memory is mapped in two locations, 0 to 0x22 and 0x100 to 0x122. The lower area mapping is used in SLC-500 applications because the SLC-500 cannot read PLC-2 addresses larger than byte address 255.

The high-order nibble of Mode 8 level 2 contains the MPU station address. This value cannot be changed via the serial port.

3.2.2 DISPLAY MEMORY

Display memory is read-only memory organized in 16 bit words. Display values less than 256 will have 0 stored in the high-order byte. Database values are transmitted as two 8-bit bytes, with the low byte transmitted first. The memory address of the database value (ADDR) is a 16-bit pointer that points to the high-order byte of the 16-bit word. The memory-address pointer (ADDR) must always be even. ADDR or ADDR + SIZE should not exceed the display memory address size. See Table 5.

Example: To read motor current, ADDR is 0x130 and SIZE is 2.

TABLE 2. SET POINT MEMORY

| LOW | HIGH | | | SET POINT (16 Bit) | RANGE | DELETE | INCREMENT |
|------------------------------------|---------------------|---------------------|---------------------|------------------------|------------|-------------|-----------|
| DEC ⁽¹⁾ BYTE ADDR | HEX BYTE ADDR | OCT WORD ADDR | DEC WORD ADDR | | | | |
| 0 | 0x100 | 0200 | 128 | I ² t Trip | 1-45 | 46 | 1 |
| 2 | 0x102 | 0201 | 129 | I ² t Alarm | 1-45 | 46 | 1 |
| 4 | 0x104 | 0202 | 130 | Overcurrent Trip | 100-600 | 625 | 25 |
| 6 | 0x106 | 0203 | 131 | Overcurrent Alarm | 100-600 | 625 | 25 |
| 8 | 0x108 | 0204 | 132 | Undercurrent Trip | 15-100 | 101 | 1 |
| 10 | 0x10A | 0205 | 133 | Undercurrent Alarm | 15-100 | 101 | 1 |
| 12 | 0x10C | 0206 | 134 | Unbalance Trip | 5-75 | 76 | 1 |
| 14 | 0x10E | 0207 | 135 | Unbalance Alarm | 5-75 | 76 | 1 |
| 16 | 0x110 | 0210 | 136 | Temperature Trip | 50-220 | 225 | 5 |
| 18 | 0x112 | 0211 | 137 | Temperature Alarm | 50-220 | 225 | 5 |
| 20 | 0x114 | 0212 | 138 | Earth-Leakage Trip | 1-100 | 101 | 1 |
| 22 | 0x116 | 0213 | 139 | Earth-Leakage Alarm | 1-100 | 101 | 1 |
| 24 | 0x118 | 0214 | 140 | FLA | (.45-.93) | *CT-Primary | Rating |
| 26 | 0x11A | 0215 | 141 | Service Factor | 100-125 | | 1 |
| 28 | 0x11C | 0216 | 142 | Mode 8 Level 1 | 0-255 | | 1 |
| 30 | 0x11E | 0217 | 143 | Mode 8 Level 2 | 0-255 | | 1 |
| 32 | 0x120 | 0220 | 144 | CT-Primary Rating | 20-1200 | | 5 |
| 34 | 0x122 | 0221 | 145 | EFCT-Primary Rating | 5, 50-2000 | | 50 |

⁽¹⁾ This is the data offset in the SLC message instruction.



TABLE 3. DISPLAY MEMORY

| LOW | | HIGH | | DESCRIPTION |
|---------------------|---------------------|---------------------|---------------------|----------------------------------|
| DEC BYTE ADDR | HEX BYTE ADDR | OCT WORD ADDR | DEC WORD ADDR | |
| 48 | 0x130 | 0230 | 152 | Ammeter in Amps |
| 50 | 0x132 | 0231 | 153 | Ammeter in Percent of FLA |
| 52 | 0x134 | 0232 | 154 | Peak Current |
| 54 | 0x136 | 0233 | 155 | Modulation |
| 56 | 0x138 | 0234 | 156 | Unbalance |
| 58 | 0x13A | 0245 | 157 | Temperature |
| 60 | 0x13C | 0236 | 158 | Earth Leakage (Note 1) |
| 62 | 0x13E | 0237 | 159 | Percent I _t |
| 64 | 0x140 | 0240 | 160 | Pre-Trip Current |
| 66 | 0x142 | 0241 | 161 | Pre-Trip Unbalance |
| 68 | 0x144 | 0242 | 162 | Pre-Trip Temperature |
| 70 | 0x146 | 0243 | 163 | Pre-Trip Earth Leakage (Note 1) |
| 72 | 0x148 | 0244 | 164 | Pre-Trip I _t |
| 74 | 0x14A | 0245 | 165 | Reset Time |
| 76 | 0x14C | 0246 | 166 | Peak Temperature During ETR |
| 78 | 0x14E | 0247 | 167 | Station Address of MPU |
| 80 | 0x150 | 0250 | 168 | Trip Status Bits |
| 82 | 0x152 | 0251 | 169 | Alarm Status Bits |
| 84 | 0x154 | 0252 | 170 | Motor Status Bits |
| 86 | 0x156 | 0253 | 171 | Communications Software Revision |

NOTE (1): Divide reading by 10 for actual amperes. Resolution 1/10 A.

3.2.3 COMMAND MEMORY

The command memory is mapped in two locations, 0xF0 (to support SLC-500) and 0x1F0. This is a 16-bit location used to write the commands listed in Table 4.

TABLE 4. COMMAND MEMORY

| DATA | DESCRIPTION |
|------|-----------------------------------|
| 0000 | Null Function (Note 2) |
| 0001 | Trip Reset |
| 0002 | Latched-Alarm Reset |
| 0003 | Clear Peak Current and Modulation |
| 0004 | Emergency Thermal Reset |
| 0005 | Re-enable Temperature Set Point |
| 0006 | Fbad Reset |

NOTE (2): This function accesses the MPU-16A but does not perform any function. Used for testing.

3.2.4 TRIP-STATUS-BIT DEFINITIONS

The trip-status bits indicate the MPU-16A trip conditions.

TABLE 5. TRIP-STATUS BITS

| BIT NUMBER | TRIP FUNCTION |
|------------|-------------------------|
| 0 (LSB) | 1 = I _t Trip |
| 1 | 1 = Overcurrent Trip |
| 2 | 1 = Undercurrent Trip |
| 3 | 1 = Unbalance Trip |
| 4 | 1 = Temperature Trip |
| 5 | 1 = Earth-Fault Trip |
| 6 | 1 = Short-Circuit Trip |
| 7 | 1 = Fbad Trip |
| 8 | 1 = Phase-Reverse Trip |



3.2.5 ALARM-STATUS-BIT DEFINITIONS

The alarm-status bits indicate the MPU-16A alarm conditions.

TABLE 6. ALARM-STATUS BITS

| BIT NUMBER | ALARM FUNCTION |
|------------|--------------------------|
| 0 (LSB) | 1 = I ^t Alarm |
| 1 | 1 = Overcurrent Alarm |
| 2 | 1 = Undercurrent Alarm |
| 3 | 1 = Unbalance Alarm |
| 4 | 1 = Temperature Alarm |
| 5 | 1 = Earth-Leakage Alarm |
| 6 | Not Used |
| 7 | 1 = Fbad Alarm |
| 8 | 1 = Shorted-RTD Alarm |
| 9 | 1 = Open-RTD Alarm |

3.2.6 MOTOR-STATUS DEFINITIONS

The motor-status bits define the motor/MPU status.

TABLE 7. MOTOR-STATUS BITS

| BIT NUMBER | FUNCTION |
|------------|-----------------------------------|
| 0 (LSB) | 1 = Motor Current > 10% (Running) |
| 1 | 1 = Motor In Run State |
| 2 | 1 = ETR On |

4. MPU-16A DATA LOGGING OPTION

NOTE: This data is not accessible using the SLC-500.

The MPU-16A data logger captures time-stamped meter data using either a time or event trigger mechanism. Captured records are stored in non-volatile memory, which has a data retention of at least 10 years. The real-time clock (RTC) continues to operate even without control voltage.

Configuration registers are used to configure the data logger. The data logger allows for multiple writes to the configuration registers.

4.1 CONFIGURATION REGISTERS

Table 8 shows the address location of each register.

4.2 REGISTER DEFINITIONS

16-bit registers are used to configure the data logger. The least significant bit is Bit 0.

0x200: (Read/Write)

YEAR: 1995 to 2094 BCD (Bits 0:15)

Writes to the high-order byte of YEAR are ignored. The data logger will automatically set the YEAR based on the value in the low-order byte.

For low-byte BCD values up to 94, the BCD value in the high byte is 20 to cover the range 2000 to 2094. For low-byte BCD values greater than 94, the high byte is 19 to cover the range 1995 to 1999.

0x202: (Read/Write)

MONTH: 01 to 12 BCD (Bits 8:15)

DATE: 01 to 31 BCD (Bits 0:7)

0x204: (Read/Write)

DAY: 01 to 07 BCD (Bits 8:15)

HOUR: 00 to 23 BCD (24 Hour format) (Bits 0:7)

0x206: (Read/Write)

MINUTES: 00 to 59 BCD (Bits 8:15)

SECONDS: 00 to 59 BCD (Bits 0:7)

0x208: (Read/Write)

SAMPLE INTERVAL: 1 to 65536 Seconds (Bits 0:15)

A sample interval of 0 is not valid.

0x20A: (Read/Write)

POST TRIGGER DURATION: 0 to 249 (Bits 0:7) (Valid in event-mask-trigger mode only). The duration count specifies the number of additional records captured after an event-trigger occurs. The time between records is defined by the sample interval.

If a trigger occurs while the duration counter is active, this record will be captured but the duration count will not be initialized. The duration count is initialized only at the occurrence of the first event.

0x20C: (Read/Write)

CONTROL:

MODE: (Bits 0:2)

0: Disable data logging.

1: Set trigger to TIME and start recording.

2: Set trigger to EVENT MASK mode and enable trigger.

3: Not used.

CLEAR COUNTER: (Bit 3)

0: The record counter is not cleared.

1: The record counter is cleared.

This bit is cleared by the data logger when the counter has been cleared.

CLOCK ENABLE: (Bit 4)

0: Clock OSC is turned off. (RTC not running)

1: Clock OSC is on.

0x20E: (Read/Write)

TRIP STATUS TRIGGER MASK: (Bits 0:15) Bits that are set in the mask register enables triggering for the corresponding trip-status bit. For triggering to occur, the selected trip-status bits must be all zero prior to one of the bits going high.



0x210: (Read/Write)

ALARM STATUS TRIGGER MASK: (Bits 0:15) Bits that are set in the mask register enables triggering for the corresponding alarm-status bit. For triggering to occur, the selected alarm-status bits must be all zero prior to a transition to 1.

0x212: (Read/Write)

MPU-16A STATUS TRIGGER MASK: (Bits 0:15) Bits that are set in the mask register enables triggering for the corresponding MPU-16A status bit. If any of the enabled bits change state, triggering occurs.

0x214: (Read Only)

RECORD COUNTER: Counts the number of records captured. This is a read-only location and is cleared by using the control register.

4.3 TRIGGER DESCRIPTION

With the trigger mode set to TIME, the data logger stores records at fixed time intervals. The time unit is defined by SAMPLE INTERVAL. In the TIME mode, any trip, alarm or MPU-16A status that matches the mask bits will also be recorded. TRIGGER DURATION does not apply in TIME mode. When the number of records exceeds 250, new records overwrite old records.

With the trigger mode set to EVENT MASK, the data logger is configured to trigger on a specific trip, alarm or MPU-16A status condition. The trigger-mask bits define which trip, alarm or MPU-16A status bits will initiate the

trigger. Event mask bit locations correspond to the trip-status, alarm-status, and MPU-16A status bits defined in the communications protocol. To enable triggering on a status bit, the corresponding mask bit is set. All selected bits in the trip or alarm status must be zero to arm the trigger. When any or all of the bits in the trip or alarm status transition from zero to one, the data-logger will be triggered. When triggered, the data logger will store the number of records defined by TRIGGER DURATION with a time interval defined by the sample unit/interval settings. In the case of the MPU-16A status, not all bits have to be zero to arm the trigger. Any bit that changes state causes a trigger.

4.4 DATA-LOGGING RECORD FORMAT

Up to 250 records are stored in non-volatile memory. These records are read-only and are retrieved by specifying the starting address and length for the record. Each record requires a separate read request. The first record (record 0) is always the latest record, and record 249 is always the last record. Each record consists of the data shown in Table 11 (Record 0 addresses shown).

The starting address (decimal) for a record is defined by:

- Address = **768** + (Record_Number*48)
- Where Record_Number=0 is the latest record.

NOTE: The record length is a maximum of 24 words or 48 bytes.

TABLE 8. CONFIGURATION REGISTERS

| HEX BYTE ADDRESS | OCT WORD ADDRESS | DEC WORD ADDRESS | DESCRIPTION |
|------------------------|------------------------|------------------------|-----------------------------------|
| 0x200 | 400 | 256 | 4-Digit Year (BCD) |
| 0x202 | 401 | 257 | MSB: Month LSB: Date (BCD) |
| 0x204 | 402 | 258 | MSB: Day LSB: Hour (BCD) |
| 0x206 | 403 | 259 | MSB: Minute LSB: Second (BCD) |
| 0x208 | 404 | 260 | Sample Interval in Seconds |
| 0x20A | 405 | 261 | Trigger Duration |
| 0x20C | 406 | 262 | Control |
| 0x20E | 407 | 263 | Trip Status Trigger Mask |
| 0x210 | 410 | 264 | Alarm Status Trigger Mask |
| 0x212 | 411 | 265 | MPU-16A Status Trigger Mask |
| 0x214 | 412 | 266 | Record Counter (Read Only) |



TABLE 9. DATA LOGGER RECORD FORMAT

| HEX BYTE ADDRESS | OCT WORD ADDRESS | DEC WORD ADDRESS | DESCRIPTION |
|------------------------|------------------------|------------------------|---|
| 0x300 | 600 | 384 | 4-Digit Year (BCD) MSB: Month LSB: Date (BCD) MSB: Day LSB: Hour (BCD) MSB: Minute LSB: Second (BCD) Trip Status Alarm Status MPU-16A Status Ammeter (A) Ammeter (%) Unbalance (%) Temperature Earth Leakage (x10 A) Percent I ² t (%) Pre-Trip Current (A) Pre-Trip Unbalance (%) Pre-Trip Temperature (C) Pre-Trip Earth Leakage (x10 A) Pre-trip I ² t |

5. MPU-16A STATION-ADDRESS SELECTION

The second level of the Mode-8 program option is used to specify the MPU-16A station address (STN). See Table 10.

Value digits 2 and 3 indicate a decimal address from 0 to 63. Address 0 is the default value and inhibits serial communication.

Value digit 1 indicates the relay-operating mode.


6. CONFIGURATION SWITCHES

Eight DIP switches are located on the back of the communications card. The DIP switches are accessible through the slot on the back of the MPU-16A. When viewed from the rear, SW1 is the right-most switch. A switch is CLOSED when the actuator is up (toward the PCB) and OPEN when the actuator is down (away from the PCB). SW4 and SW5 are not used.

NOTE: SW6 is used for software-update programming and MUST be in the OPEN position for normal communications.

TABLE 10. MODE-8 PROGRAM OPTIONS (2nd Level)

DEFAULT VALUE 8000

|  | |
|--|---|
| VALUE DIGIT 1 | RELAY OPERATING MODE |
| 0 | TRIP-RELAY FAIL SAFE ALARM-RELAY FAIL SAFE |
| 1 | TRIP-RELAY FAIL SAFE ALARM-RELAY NON FAIL SAFE |
| 2 | TRIP-RELAY NON FAIL SAFE ALARM-RELAY FAIL SAFE |
| 3 | TRIP-RELAY NON FAIL SAFE ALARM-RELAY NON FAIL SAFE |

| VALUE DIGITS 2 & 3 | MPU ADDRESS |
|-----------------------|--------------------------|
| 0 0 | COMMUNICATIONS INHIBITED |
| 0 1 | MPU 1 |
| . | . |
| . | . |
| . | . |
| 6 3 | MPU 63 |



6.1 BAUD RATE

Switches 1 to 3 are used to select the communication baud rate.

TABLE 11. BAUD RATE

| BAUD | SW1 | SW2 | SW3 |
|------|--------|--------|----------------|
| 9600 | OPEN | CLOSED | OPEN (Default) |
| 4800 | CLOSED | CLOSED | OPEN |
| 2400 | OPEN | OPEN | CLOSED |
| 1200 | CLOSED | OPEN | CLOSED |
| 600 | OPEN | CLOSED | CLOSED |
| 300 | CLOSED | CLOSED | CLOSED |

6.2 TURN-AROUND DELAY

Switch 7 is used to enable the turn-around or response delay.

TABLE 12. TURN-AROUND DELAY

| DELAY | SW7 |
|----------|------------------|
| Enabled | CLOSED (Default) |
| Disabled | OPEN |

The response delay is a function of the baud rate selected and will not be less than the value shown in the table.

TABLE 15. RESPONSE DELAY

| BAUD RATE | DELAY |
|-----------|-------|
| 9600 | 4 ms |
| 4800 | 4 ms |
| 2400 | 8 ms |
| 1200 | 12 ms |
| 600 | 20 ms |
| 300 | 41 ms |

6.3 ERROR—CHECK TYPE

Switch 8 selects the error-checking format as block checking (BCC) or cyclic redundancy checking (CRC).

TABLE 14. ERROR CHECKING

| ERROR-CHECK TYPE | SW8 |
|------------------|------------------|
| BCC | CLOSED (Default) |
| CRC | OPEN |

7. SPECIFICATIONS

| | |
|------------------|---|
| Interface..... | Isolated RS485, 2-wire multi-drop, half duplex. |
| Protocol | AB Half Duplex DFI/ master-slave. |
| Baud Rate | 300 to 9600 Baud. |
| Bit Format | 8 bits, no parity, one stop bit.* |

Number of MPU's Connected Maximum of 30 units. ♦
Line length 1200 meters total.
Isolation Voltage..... 300 Vac continuous
Dielectric..... 1500 Vac

* Terminal 23 (-) is negative with respect to terminal 24 (+) for a binary 1 (MARK or OFF) state.

Terminal 23 (-) is positive with respect to terminal 24 (+) for a binary 0 (SPACE or ON) state.

♦ Can be expanded to 62 units with repeater.

8. INTERFACE CONVERTER

A communication master with a RS-232 port requires an SE-485-PP RS-232 to RS-485 converter. This converter monitors the data from the master and sets the transmitter ON or OFF based on activity on the RS-232 transmit line.

The SE-485PP is a port-powered converter. When used on line-lengths greater than 25 meters, a separate 12-Vdc supply is recommended to power the converter. See Fig. 1.

8.1 NETWORK INTERCONNECTION

MPU-16 communication ports are interconnected using a two-wire twisted pair cable. Communication ports are connected in a daisy-chain method. All MPU-16 (+) terminals are connected to the (B) terminal on the converter and all MPU-16 (-) terminals are connected to the (A) terminal on the converter.

8.2 RS-485 TERMINATION

Termination resistors are required for line lengths greater than 25 meters. Termination resistors are normally selected to match the characteristic impedance of the communication line, and are installed at each end of the network.

When the RS-485 line is idle, all of the RS-485 devices are in a receive state and the RS-485 bus voltage is not defined.

To force the RS-485 line to a known state, each MPU-16 has a 100K pull-up resistor connected from the internal 5-volt supply to the (+) line and a 100K pull-down resistor connected from the (-) terminal to internal circuit ground.

The combination of the pull-up, pull-down, and termination resistances must result in a voltage on the RS-485 line that is greater than the 200 mV threshold of the RS-485 receiver to guarantee a valid idle state.

For the RS-485 network used with the MPU-16, the recommended termination is an SE-TA485. This termination consists of a 150-ohm resistor in series with a 0.1 µf capacitor.



9. PLC-5 PROGRAMMING

9.1 CHANNEL CONFIGURATION

MPU-16A communication can only be established using channel 0. In the channel overview menu, select SYSTEM (MASTER) for channel 0.

A typical channel configuration is shown below.

9.2 MESSAGE INSTRUCTION

The message instruction (MG) is used to read data to or write data from the MPU-16A. The following is a message instruction to read 18 words of data starting at MPU-16A word address 200. The data is stored starting at PLC-5 file address N11:0.

| | |
|---------------------------------|------------------------|
| Communication Command: | PLC-2 Unprotected Read |
| PLC-5 Data Table Address: | N11:0 |
| Size In Elements: | 18 |
| Local/Remote: | Local |
| Remote Station: | N/A |
| Link ID: | N/A |
| Remote Link Type: | N/A |
| Local Node Address: | 1 |
| Destination Data Table Address: | 200 |
| Port Number: | 00 |

9.2.1 COMMUNICATION COMMAND

For reading data use PLC-2 UNPROTECTED READ.
For write command use PLC-2 UNPROTECTED WRITE.

9.2.2 PLC-5 DATA TABLE ADDRESS

For write instructions, this is the starting address of the data in the PLC to be sent to the MPU-16A. The element size is always 1 for write instructions to the MPU-16A. The following is a message instruction to perform reset functions.

| | |
|---------------------------------|-------------------------|
| Communication Command: | PLC-2 Unprotected Write |
| PLC-5 Data Table Address: | N19:0 |
| Size In Elements: | 1 |
| Local/Remote: | Local |
| Remote Station: | N/A |
| Link ID: | N/A |
| Remote Link Type: | N/A |
| Local Node Address: | 001 |
| Destination Data Table Address: | 370 |
| Port Number: | 00 |

In this instruction, the reset code stored in N19:0 is sent to MPU-16A #1 location 370.

For read instructions, the Data Table Address specifies the starting address within the PLC where the data from the MPU-16A will be stored. The starting address in the MPU-16A and element size must be within the data base range of the MPU-16A.

9.2.3 SIZE IN ELEMENTS

Specifies the number of words to read or write. The element size is always 1 for write instructions.

SYSTEM MODE (DFI MASTER) CHANNEL 0 CONFIGURATION

| | | | |
|-----------------------------|----------------|-------------------------|------|
| Diag. file: | N10 | System mode char.: | S |
| Remote mode change: | DISABLED | User mode char.: | U |
| Mode attention char.: | \0x1b | | |
| Baud rate: | 9600 | Parity: | NONE |
| Stop bits: | 1 | Station address: | 0 |
| Control line: | NO HANDSHAKING | | |
| Reply msg wait (20 ms): | 50 | Error detect: | BCC |
| ACK time-out (20 ms): | 50 | RTS send delay (20 ms): | 0 |
| DF1 retries: | 3 | RTS off delay (20 ms): | 0 |
| Msg appl time-out (30 sec): | 1 | | |

Polling mode: MESSAGE BASED (Do Not Allow Slave To Initiate Messages)
Master message transmit: BETWEEN STATION POLLS

| | | | |
|------------------------|-----|--------------------------|-----|
| Normal pole node file: | N11 | Priority poll node file: | N12 |
| Active station file: | B13 | Normal poll group size: | 3 |

The station address is the address of the master not the MPU-16A address.



9.2.4 LOCAL/REMOTE

This setting should be set to Local. All MPU-16A's are local units connected to the PLC. Remote Station, Link ID, and Remote Link Type are N/A.

9.2.5 LOCAL NODE ADDRESS

This is the address of the MPU-16A connected to the local link.

9.2.6 DESTINATION DATA TABLE ADDRESS

Specifies the starting address in the MPU-16A of the sources or destination data.

9.2.7 PORT NUMBER

Specifies the channel for communications and must always be 0 for MPU-16A communications.

9.3 DIAGNOSTICS

The PLC-5 Data Monitor screen can be used to determine if the message instructions are executing properly. The PLC-5 Programming Software manual provides detailed descriptions of the status bits and error codes.

MESSAGE INSTRUCTION DATA MONITOR FOR CONTROL BLOCK MG9:1

| | | | |
|---------------------------------|------------------------|-----------------------|------|
| Communication Command: | PLC-2 UNPROTECTED READ | | |
| PLC-5 Data Table Address: | N17:10 | ignore if timed-out: | 0 TO |
| Size in Elements: | 19 | to be retried: | 0 NR |
| Local/Remote | LOCAL | awaiting execution: | 1 EW |
| Remote Station: | N/A | continuous: | 1 CO |
| Link ID: | N/A | error: | 0 ER |
| Remote Link Type: | N/A | message done: | 1 DN |
| Local Node Address: | 001 | message transmitting: | 0 ST |
| Destination Data Table Address: | 230 | message enabled: | 1 EN |
| Port Number: | 00 | | |
| Error Code: | 0000 (HEX) | | |

The channel-0 status screen shows error counters that provide an overview of communications errors.

SYSTEM MODE (DF1 MASTER) CHANNEL 0 STATUS

| | | | |
|----------------------------------|-------|------------------------------|--------|
| DCD Recover: | 0 | Lost Modem: | 0 |
| Message sent: | 2494 | Undelivered messages: | 0 |
| Messages received: | 2494 | Messages retry: | 0 |
| EOT received on first poll: | 0 | Bad packet/no ACK: | 0 |
| | | Duplicate messages received: | 0 |
| Normal poll list scan (100 ms) | | | |
| | last: | 0 | max: 0 |
| Priority poll list scan (100 ms) | | | |
| | last: | 0 | max: 0 |
| Modem lines | | | |
| DTR | DCD | DSR | RTS |
| ON | ON | ON | OFF |
| | | | CTS |
| | | | OFF |



10. SLC-500 APPLICATIONS

10.1 CHANNEL CONFIGURATION

Channel 0 (RS-232) is used for MPU communications. As a result, this port cannot be used as a programming port. Use the DH+ port for programming.

Set channel 0 for DF1 Half-Duplex Master, 9600 baud, and no parity. The SE-485-PP, RS-232 to RS-485 converter connects directly to the RS-232 port on the SLC-5/04 processor.

10.2 READ MESSAGES

Set the message information as follows:

Read/Write: Read
Target Device: 485CIF
Local/Remote: Local
Control Block: N7:0

The 485CIF selection enables PLC-2 addressing required by the MPU-16A. The Control Block file contains the SLC MSG configuration data and is selectable by the user.

Set the Data Table Address to the destination file (N9:0) in the SLC. The Size in Elements specifies the number of registers to read from the MPU. The Data Table Offset specifies the byte offset in the MPU where the data read starts. For example, to read all display memory, set the Size in Elements to 20 and set the Data Table Offset to 48 (start of display memory).

10.3 WRITE MESSAGES

Data can be written to set-point and command memory. For the SLC, the set-point address range is 0 to 34. Command memory is located at 250 (0xF0).

Set the message information as follows:

Read/Write: Write
Target Device: 485CIF
Local/Remote: Local
Control Block: N7:0

The data Table Address is set to the location in the SLC where the data is located (N9:0). Size in Elements must be 1. Set the Data Table Offset to the byte address location in the MPU where the data is to be sent. For example, to reset the MPU, enter 1 in the N9:0 location and set the Data Table Offset to 250. When the message runs, the reset command is sent to the MPU.

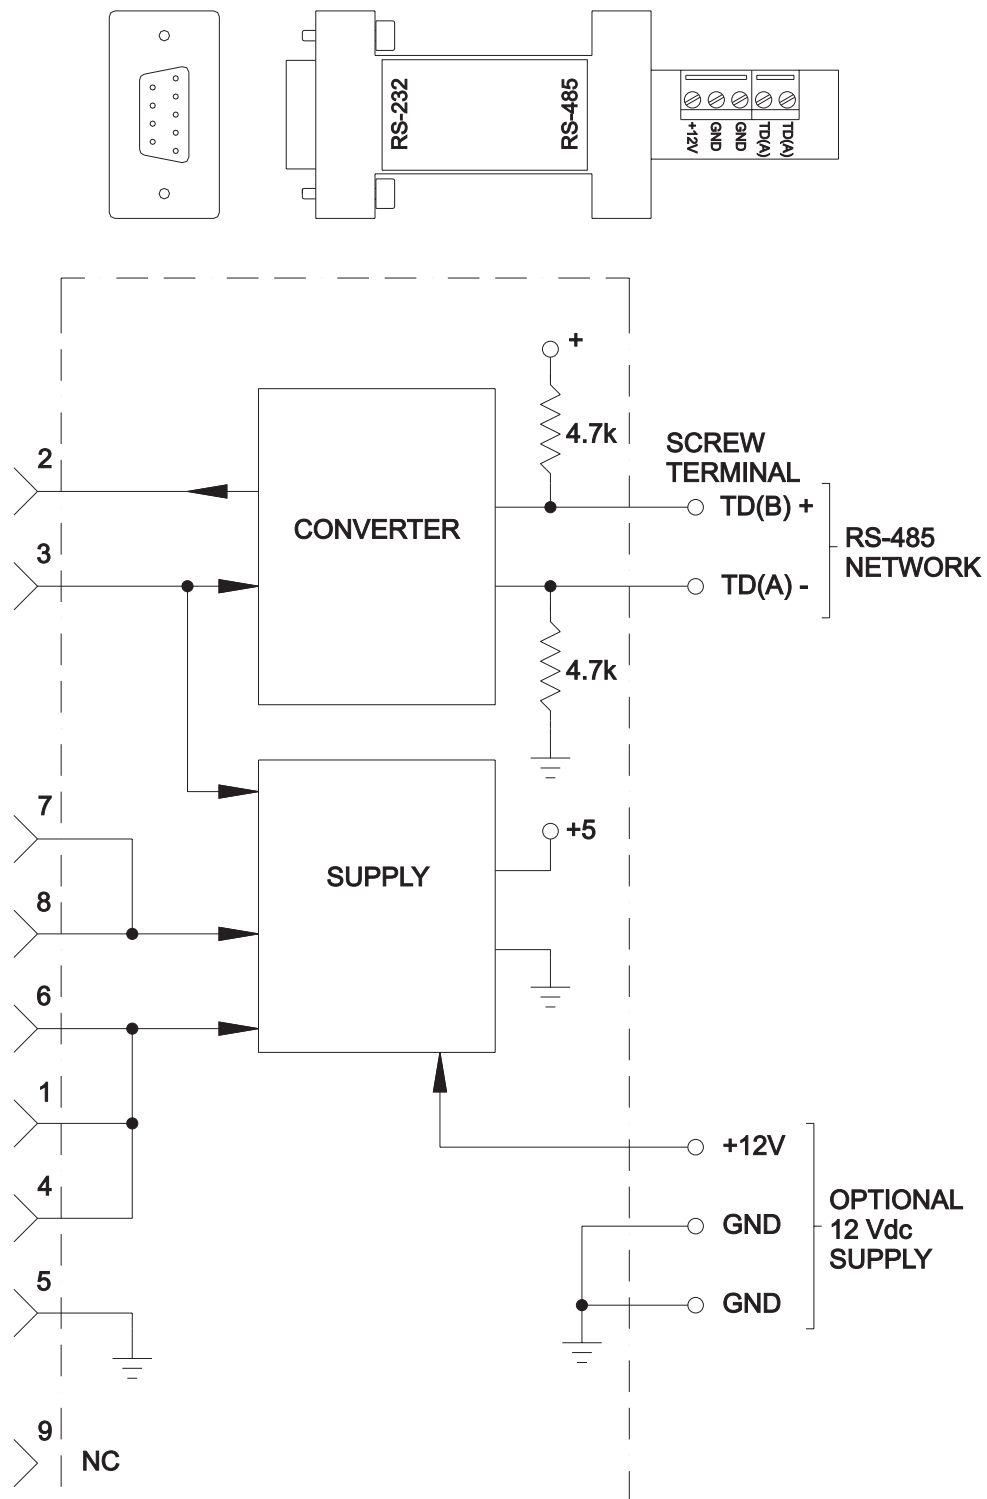


FIGURE 1. SE-485-PP Port Powered RS-232 to RS-485 Converter.